



Niue Strategic Energy Road Map 2015–2025



Government of Niue



Niue Strategic Energy Road Map 2015–2025

Government of Niue



**Secretariat of the Pacific Community
Suva, Fiji
2015**

© Copyright Government of Niue 2015

All rights for commercial/for profit reproduction or translation, in any form, reserved.

Original text: English

Secretariat of the Pacific Community cataloguing-in-publication data

Niue Strategic Energy Road Map 2015–2025 / Government of Niue

1. Energy – Management – Niue.
2. Renewable energy sources – Niue.
3. Power resources — Niue.
4. Energy — Government policy — Niue.
5. Energy policy — Niue.

I. Title II. Niue III. Secretariat of the Pacific Community

333.79099626

AACR2

ISBN: 978-982-00-0939-4

Prepared for publication at SPC's Suva Regional Office, Private Mail Bag, Suva, Fiji, 2015

Printed by Quality Print, at Suva, Fiji, 2015

Contents

Abbreviations	vii
Foreword	1
Niue's Strategic Energy Road Map.....	3
1 Introduction	6
1.1 Purpose and drivers of the NiSERM	6
1.1.1 National.....	6
1.1.2 Regional and global.....	6
1.1.3 Energy access and links to development.....	6
1.2 How the NiSERM was developed	7
2 Niue's energy balance	8
3 Electricity sub-sector.....	13
3.1 Generation and supply	13
3.2 Peak demand	14
3.3 Grid improvement and energy storage	15
3.4 Renewable energy potential	16
3.4.1 Solar energy potential	16
3.4.2 Wind energy potential	16
3.4.3 Other renewable energy technologies.....	17
3.5 Energy efficiency and conservation potential	17
3.5.1 Electricity supply losses.....	17
3.5.2 Residential, commercial and government.....	18
3.5.3 The commercial sector	19
3.5.4 The government sector	19
3.5.5 The tourism sector	19
3.5.6 Appliance labelling and standards	20
3.5.7 LPG rehabilitation.....	20
3.6 Electricity sub-sector targets.....	20
4 Transport sub-sector.....	23
4.1 Transport energy use	23
4.2 Land transport.....	23
4.3 Transport sub-sector targets	23
5 Petroleum sub-sector.....	26
5.1 Fuel supply and demand	26
5.2 Fuel pricing.....	28
5.3 Petroleum sub-sector targets.....	29
4.4 Achieving government leadership and commitment.....	29
6 Policies to sustainable energy opportunities in Niue.....	31
6.1 Concrete policies and measures	31
6.1.1 Encouraging and improving energy efficiency	31
6.1.2 Incentivising renewable energy deployment	32
6.1.3 Training and capacity building.....	32
6.1.4 Data collection and analysis.....	33

7	NiSERM financing plan.....	35
7.1	Financial savings analysis	35
7.2	Financing the road map	39
	NiSERM implementation framework	41
7.2	Roles and responsibilities.....	41
8	NiSERM monitoring and evaluation plan.....	43
8.1	Monitoring	43
8.2	Evaluation.....	43
10.	Annexes.....	45
	Annex 1: People and organisations consulted.....	45
	Annex 2: References.....	45
	Annex 3: Niue Energy Balance.....	47
	Annex 4: NiSERM Monitoring Plan	48

List of tables

Table 1: Niue’s socio-economic indicators.....	7
Table 2: Total installed diesel capacity and solar PV capacity.....	14
Table 3: Total generation diesel and solar 2009–2014	14
Table 4: Wind energy status in some selected Pacific Island countries.....	16
Table 5: Energy savings through lighting strategy	19
Table 6: Energy savings through AC retrofit	19
Table 7: Total consumption (TJ) of LPG per sector 2010–2014.....	20
Table 8: Electricity sub-sector goals and targets	21
Table 9: Land transport target.....	24
Table 10: Pacific region fuel quality.....	27
Table 11: Petroleum sub-sector targets.....	29
Table 12: Potential savings breakdown	38
Table 13: NiSERM estimated investment.....	39

List of figures

Figure 1: Percentage of primary energy supply in 2014.....	10
Figure 2: Total primary energy supply 2009 to 2014	10
Figure 3: 2014 Production and import	11
Figure 4: 2014 Total final energy consumption	11
Figure 5: Total electricity generation and peak demand, June 2013.....	13
Figure 6: Annual peak demand actual and projections from 2010–2030	15
Figure 7: Electricity consumption trend 2009 to 2014	18
Figure 8: Fuel use for transport sector 2009 to 2014.....	23
Figure 9: Petroleum fuel and LPG sales projects 2015–2018	26
Figure 10: Regional prices of LPG (including tax and duty)	28
Figure 11: GoN energy grants (subsidies).....	36
Figure 12: Savings estimates	38
Figure 13: Road map implementation institutional framework	41

Abbreviations

ADO	automotive diesel oil	NPC	Niue Power Corporation
CBA	cost-benefit analysis	NZD	New Zealand dollars
cc	cubic centimetres	NZMFAT	New Zealand Ministry of Foreign Affairs and Trade
DOU	Department of Utilities	PALS	Pacific Appliance Labelling Standards
DOT	Department of Transport	PECF	Pacific Environment Community Fund
DPK	dual purpose kerosene	PICs	Pacific Island countries
DSM	demand side management	PICTs	Pacific Island countries and territories
EE	energy efficiency	PIREP	Pacific Islands Renewable Energy Project
EDF	European Development Fund	PMCU	Project Monitoring and Coordination Unit
FAESP	Framework for Action on Energy Security in the Pacific	PPA	Pacific Power Association
GDP	gross domestic product	PPM	parts per million
Gj	gigajoules	PV	photovoltaic
GoN	Government of Niue	RE	renewable energy
GVW	Gross vehicle weight	REP	Renewable Energy Programme
HDI	human development index	RON	Research Octane Number
HSFO	high-sulfur fuel oil	SAIDI	System average interruption duration index
IUCN	International Union for Conservation of Nature	SE4ALL	(United Nations) Sustainable Energy for All initiative
JICA	Japanese International Cooperation Agency	SIDS	small island developing states
kVAr	kilo volts ampere reactive	SPC	Secretariat of the Pacific Community
kW	kilowatt	TJ	terajoule
kWh	kilowatt-hour	UNDP	United Nations Development Programme
kWp	kilowatt-peak	USP	University of the South Pacific
LPG	liquefied petroleum gas	USD	United States dollars
MOI	Ministry of Infrastructure		
MP	Monitoring plan		
MWh	megawatt hour		
NBF	Niue Bulk Fuel		
NiSERM	Niue Strategic Energy Road Map		
NNSP	Niue National Strategic Plan		

Foreword



Foreword

At the global level, the world leaders have adopted the 2030 Agenda for Sustainable Development which consists of 17 goals endorsed the post 2015 UN Sustainable Development Goals and it is pleasing to see **Goal 7 – Ensure access to affordable, reliable, sustainable and modern energy for all.** Countries the world over need modern energy and Niue is no exception.

At the regional level, at the 46th Pacific Islands Forum leaders' meeting in Papua New Guinea on the theme *Strengthening connections to enhance Pacific regionalism*, we recognised that our shared quest for greater energy security and accessibility is vital to promote regional connectivity in three core areas: people to people, institutional and physical connectivity. Energy security enables cost-effective transportation in our region to connect people by road, water and air. It enables modern communication technologies to effectively connect people and institutions and address the tyranny of distance and remoteness. Equally, it will enable construction of infrastructure such as bridges, roads, wharves and airports to physically connect our villages, islands and communities to markets.

This *Niue Strategic Energy Road Map 2015–2025* is government's effort, at the national level, to work with its national and regional partners and the global community to unlock the development potential of Niue and to contribute to addressing the challenges of climate change. This roadmap represents a whole-of-government approach to addressing the energy security challenges of Niue, an approach that looks at the entirety of the energy sector – electricity, renewable energy, energy efficiency and petroleum – and has all the partners working together as one team in its implementation.

Energy security for Niue encompasses everyone's access to modern, reliable and safe energy services. It includes energy generation, distribution and consumption becoming more cost-efficient and affordable, and the energy infrastructure in Niue becoming climate-proof and based on a low carbon approach.

I acknowledge the technical assistance and guidance provided by the Secretariat of the Pacific Community in the development of this road map, and the time, effort and commitment our Niue national team gave to its completion.

I commend this road map and its contents to your attention, as we all work hand-in-hand towards a prosperous Niue.



Honorable Dalton Tagelagi
Minister of Infrastructure



Honorable Dalton Tagelagi
Minister of Infrastructure

Energy Road Map summary



Niue's Strategic Energy Road Map

Overall vision

The *Niue Strategic Energy Road Map 2015–2025* (NiSERM) builds on the 2005 Niue National Energy Policy and the Niue National Strategic Plan (NNSP) 2014–2019, and is aligned to current national, regional and international emerging issues relating to the energy sector.

Having joined other Forum Islands Pacific Leaders in endorsing the *Framework for Action on Energy Security in the Pacific* (FAESP) in 2010 and the *Majuro Declaration for Climate Leadership* in 2013, Niue is committed to achieving its energy goals and to be guided by four key elements of energy security:

- access to modern energy services;
- affordability of energy;
- energy efficiency and productivity; and
- environmental sustainability.

The Government of Niue (GoN) decided to develop the NiSERM to guide the whole-of-country approach towards achieving a vision shared by the government, public stakeholders, private operators, communities and development partners, the vision of:

A sustainable and secure energy sector

Goals and targets

This NiSERM aligns itself with GoN objectives in improving energy security and low carbon developments with a focus on three energy sector goals.

Goal 1: Significant renewable energy integration to the grid

Current description

- Niue currently has excess diesel generating capacity: four diesel generator engines with a total installed capacity of 2084 kW. However, only two of these, with a capacity of 1026 kW (49%) are being regularly used, while the other 51% acts as reserve capacity.
- In 2014, the total installed solar PV capacity in Niue reached 343 kWp, with 150 kWh battery storage for smoothing purposes of voltage and frequency into the grid. This is equivalent to 14% of the total installed capacity.
- In 2014, the percentage of solar PV generation in total electricity generation was 1.99%, while 98.01% was from diesel.
- Though Niue has 343 kWp of solar PV installed capacity, currently only around 80 kWp of solar PV is connected to the grid, due to grid instability considerations. The remaining 263 kWp of solar PV capacity is currently offline.

Target

- 80% renewable energy generation by 2025

Goal 2: Improve energy efficiency in the electricity and transport sub-sectors

Current description

- In 2014, around 1.27 million litres of diesel was imported into Niue, of which 75% was used for power generation. The remainder was mostly used for transportation.
- In 2014, around 1785 motor vehicles were registered: 31% cars, 24% vans, 23% light trucks and 21% motor vehicles and scooters.
- Electricity generation from fossil fuel use is highly subsidised; in 2014, government provided a subsidy of NZD 0.63 per kWh.
- In 2014, billed electricity was recorded for three sectors: commercial (43%), residential (37%) and government (20%) respectively. In addition to this, Niue has unbilled consumption for street lighting and water pumping.
- The efficiency of fuel use for power generation has shown a decrease from 4.29 kWh/litre in 2009 to 3.77 kWh/litre in 2014.
- Energy consumption in the transport sector has steadily risen by 4% annual growth during the period 2011 to 2014.

Targets

- Niue Power Corporation (NPC) station losses maintained at an acceptable level of 4% by 2020 (5.19% in 2011)
- Power generation efficiency maintained above 4 kWh/litre in 2017
- 10% electricity savings on residential, commercial and government by 2020
- 1% of fuel-efficient vehicles by 2020
- 90% of households use LPG for cooking

Goal 3: Reliable energy supply

Current description

- While data are not available for Niue, the average forced outage rate for power utility members of the Pacific Power Association (PPA) was 5.4%, as reported in the PPA/Pacific Region Infrastructure Facility power benchmarking study of 2012. In 2011, this was 8.3%. For the system average interruption duration index (SAIDI), the average was 5,664 minutes in 2012 compared to 794 in 2011.
- 100 % of fuel imported into Niue in 2014 came in rented tank-tainers.
- Fuel supply security days in 2014 was 28 days, based on monthly shipping schedules.

Targets

- Increase fuel supply security days to 60 days (baseline is 28 days in 2014).
- Keep the average forced outage to below the regional average of 5.4%.
- Keep the SAIDI to be less than the regional average goal of 200 minutes per customer.

Introduction



Introduction

1.1 Purpose and drivers of the NiSERM

1.1.1 National

The Niue National Strategic Plan (NNSP) recognises that a reliable, affordable, secure and sustainable energy supply is key to achieving prosperity for all Niueans. The purpose of the NiSERM is to create a realistic planning document to provide a systematic guide and an enabling tool for both the government and practitioners to achieve a reliable, affordable and sustainable energy supply and to complement the NNSP strategic goals, as well as those now brought on by this NiSERM.

A key driver in the development of this NiSERM is Niue's own aspiration to pursue energy security and low carbon development through sourcing 80% of its electricity needs from renewable energy sources by 2025.

Additional motivations include:

- reduced dependence on fossil fuels;
- improved energy efficiency;
- more sustainable, cleaner energy;
- improved cost-effectiveness of energy services; and
- attraction of funding for energy sector development.

There is a need to support the implementation of the NiSERM, in particular the effective delivery of electricity services, maintenance, operations and tariff collections. A regulatory framework with a matching institutional structure is equally important as part of the implementation of the NiSERM.

1.1.2 Regional and global

FAESP 2010–2020 has an Implementation Plan 2010–2015, which is currently being reviewed with the intention that such review will provide a regional road map for 2015–2020. Therefore, the NiSERM, and other national energy road maps (e.g Kiribati, Nauru, Tonga and Vanuatu) have been drafted in a manner to ensure they are consistent and concurrent with each other. The goals of the NiSERM promote low carbon development and are to be supported by the small island developing states (SIDS) sustainable energy mechanism, SIDS DOCK¹ and various platforms and partnerships established under the Sustainable Energy for All (SE4All) initiative.

The General Assembly of the United Nations has designated the years 2014–2024 the Decade of Sustainable Energy for All (SE4ALL). This initiative aims to mobilise urgent global action to three complementary objectives, to be achieved by 2030:

- ensure universal access to modern energy services;
- double the rate of improvement in energy efficiency; and
- double the share of renewable energy in the global energy mix.

1 Niue was amongst the first countries to sign the SIDS DOCK treaty at the Third SIDS Conference at Samoa in September 2014. SIDS DOCK is a SIDS–SIDS institutional mechanism established to facilitate the development a sustainable energy economy within the small island developing states. The ultimate goal of SIDS DOCK is to increase energy efficiency by 25 per cent (2005 baseline) and to generate a minimum of 50 percent of electric power from able sources and a 20–30 per cent decrease in conventional transportation fuel use by 2033.

The Decade of SE4ALL presents an opportunity to raise awareness about the importance of increasing access to sustainable energy, energy efficiency and renewable energy at the local, national, regional and international levels. The recognition is attributed to the proven reality that energy and energy services have profound positive effects on productivity, health, education, climate change mitigation, food and water security, and communications services.

1.1.3 Energy access and links to development

Empirical evidence has proven that there is significant relationship between access to modern energy and human development. Access to modern energy has improved the human development index (HDI) measure of progress on the *basic dimensions of human development* – a long healthy life, access to education and knowledge, and a decent standard of living. While not included in the HDI measure of progress, Niue has a very good social development performance and has met and or surpassed most of the Millennium Development Goals. Niue has 100% electricity penetration rate. Internet connectivity is good and available to most citizens. Niue is active in regional and international efforts to promote natural resources conservation and environmental sustainability, and to reduce the impacts of climate changes on small island developing states.

New Zealand is Niue’s primary development partner and contributes significant financial and technical support to Niue. During 2014/2015 New Zealand aid amounted to NZD 19.6 million, including budget support of NZD 7.2 million (New Zealand Ministry of Foreign Affairs and Trade 2015). Economic activity is improving and revolves around government services, which are subsidised by New Zealand aid flows. Subsistence agriculture is very important for most households in Niue. There is reduced dependence on remittances due to net-emigration to New Zealand. Like other Pacific Island countries and territories (PICTs), Niue has few exports and is dependent on imported commodities, resulting in a negative trade balance. Petroleum imports for energy generation and the transport sector account for about 15.3% of the gross domestic product (GDP) (Secretariat of the Pacific Community 2011).

Niue’s key socio-economic indicators are presented in Table 1 below;

Table 1: Niue’s socio-economic indicators

Indicator	2013
Population	1,500
GDP (Real)	NZD 24,469,000 (2012)
Total imports	NZD 15,095,733
Total exports	NZD 251,969 (2009)
Mineral imports	NZD 1,634,638
Population growth	-1% (2011)
Unemployment rate	2.7% (2011)
Trade-GDP ratio	0.6 (2011)
Electrification level	99% (2011)
Access to modern energy	99.6% (2011)
Fuel imports as a % of GDP	15.3% (2011)

1.2 How the NiSERM was developed

The NiSERM is essentially an initiative of the GoN to streamline allocation of its limited resources to effectively manage its energy sector development. The Ministry of Infrastructure (MOI) identified energy sector targets that were themselves derived from consultative processes with various public and private stakeholders, including situational and research outcomes analyses. The NiSERM is deemed the best strategic approach to achieving these targets:


In developing this NiSERM, the government went through a consultative process involving stakeholders from the public and private sector and civil society groups. The MOI conducted face-to-face consultations with the NiSERM stakeholders and a series of workshops, one held in November 2014 and second in July 2015. A list of people and organisations consulted on the development of the NiSERM is provided in Annex 1.

Other reference documents used in putting together the NiSERM are provided in the reference section attached as Annex 2.

Guiding principles

The NiSERM is guided by the principles of Niue: *ke Moniuna – a prosperous Niue* which is contained in the NNSP.

Niue energy balance

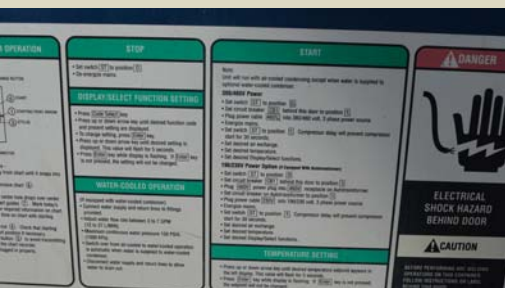

Niue's energy balance

The Niue energy sector is highly dependent on imported primary energy supply. Figure 1 shows that 99% of Niue energy supply is imported, compared to 1% of indigenous primary energy production.

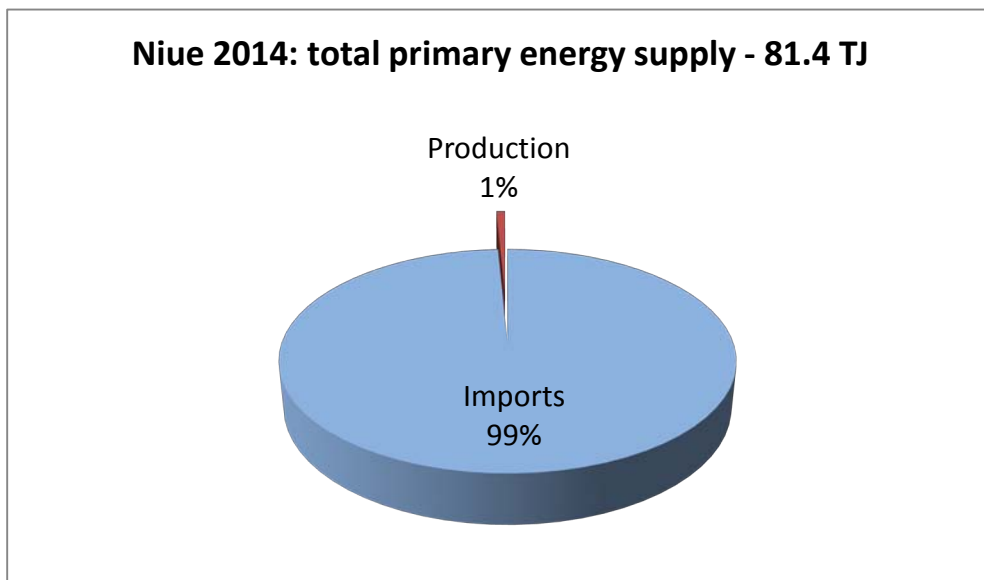


Figure 1: Percentage of primary energy supply in 2014

Source: SPC 2015

The indigenous primary energy production is limited to solar energy and biomass, while imported primary energy supply is automotive diesel oil (ADO), petrol, dual purpose kerosene (DPK) and LPG. Figure 2 shows the total primary energy supply from 2009 to 2014.

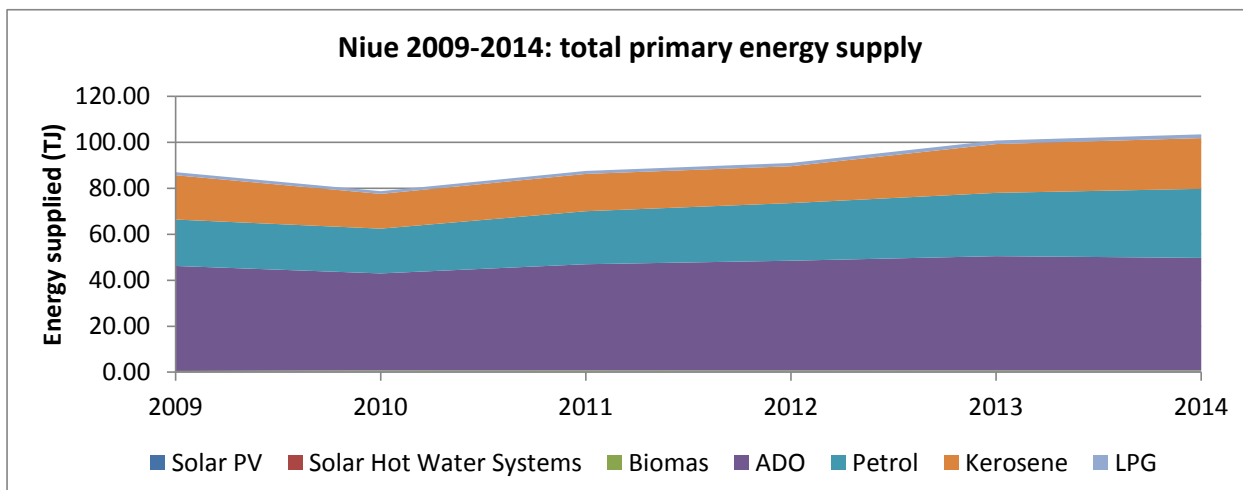


Figure 2: Total primary energy supply 2009 to 2014

Source: SPC 2015

In terms of imports in 2014 as illustrated in Figure 3, ADO accounted for 48%, petrol for 29%, kerosene for 21% and LPG for the remaining 2%. For energy produced in Niue, biomass currently meets 68% of the total energy produced with solar PV at 30% and solar water heater systems accounting for 2%.

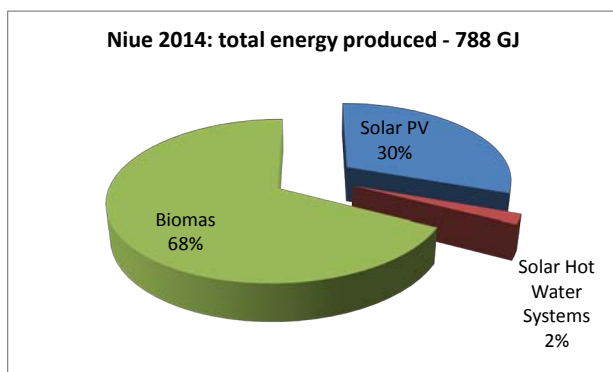


Figure 3: 2014 Production and import

Source: SPC 2015

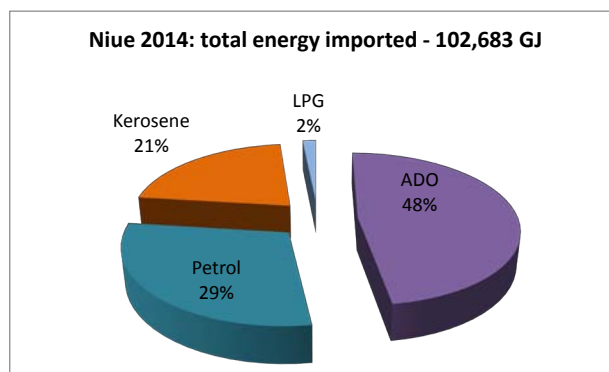


Figure 3: 2014 Production and import

Source: SPC 2015

In terms of total final energy consumption (Figure 4), in which power generation is not included as an end use sector, the highest consumption is in the transport sector with 71%, followed by residential uses (11%), commercial sector (10%), industry and government sector (7%) and agriculture, fisheries and fishing sector (1%). The energy balance attached as Annex 3 to this Road Map shows an increase of 4% annual growth rate in the transport sector since 2011 to 2014.

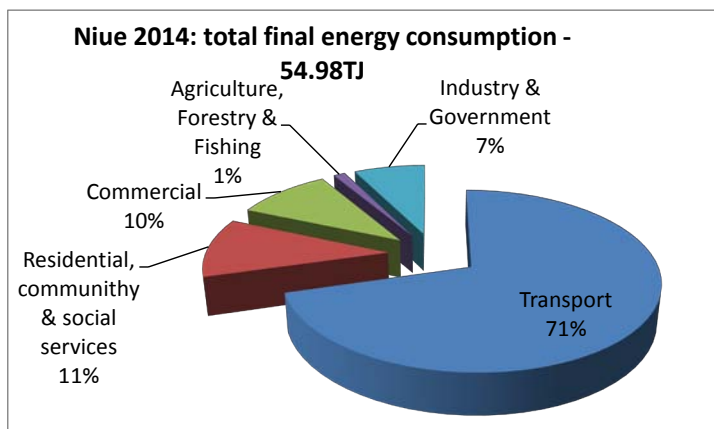


Figure 4: 2014 Total final energy consumption

Source: SPC 2015

Electricity sub-sector



Electricity sub-sector

3.1 Generation and supply

The total installed diesel generator set (gen-set) capacity is around 2,032 kW, consisting of four 508kW Caterpillar C18 gen-sets. At any point in generation, the production layout usually involves one diesel gen-set, one is placed on standby to meet peak demand loads (peak diesel), one is placed on back-up and the fourth one is under routine servicing and maintenance. The generators are controlled by Woodward 3000 controllers linked by a supervisory control and data acquisition system that controls the generator dispatch based on the island load.

A typical daily electricity generation load is shown in Figure 5. One diesel prime generator operates in the early morning from 1:00 a.m. to 5:00 a.m. when the load is at the lowest peak. The second gen-sets (diesel peak) kicks in at 6:00 a.m. and continues to run to meet the daily demand until 12:00 a.m. when the loads again recede. The peak load gradually increases from 5:00 p.m. and reaches highest peak at between 8:00 p.m. and 9:00 p.m.

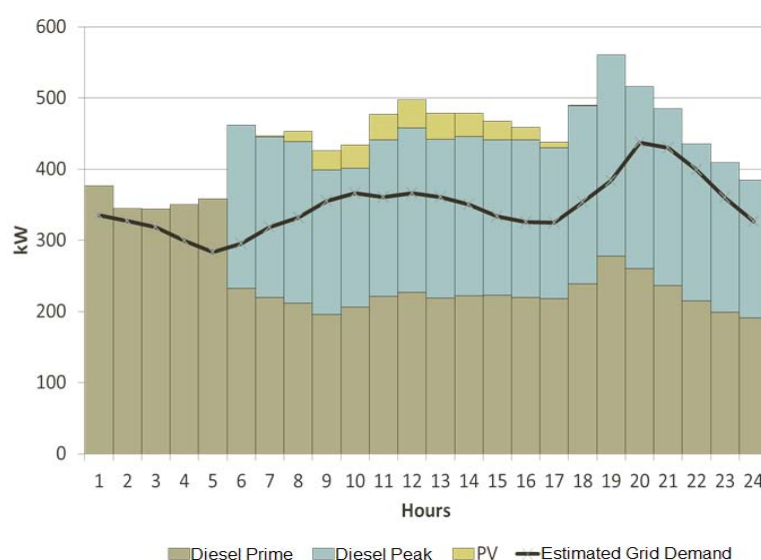


Figure 5: Total electricity generation and peak demand, June 2013.

There are 1,510 electric meters around the country but they are old and customers claim that they are faulty and give wrong readings. Replacing these meters to prepayment meters is another priority activity for the government and NPC.

Niue is 99% dependent on fossil fuel for its power generation. Since the installation of the 51.7 kWp solar PV systems from the 9th European Development Fund (EDF) in 2009, the dependence on diesel was reduced by 2.13%. Additional solar PV installations were done in 2014, which has increased the total installed grid-connected PV systems capacity to around 343.1 kWp.²

However, due to grid instability issues in November 2014, the energy generated from the additional installed solar PV has not been utilised into the electricity grid. It is the assumption that both the EDF10 and the Pacific Environment Community Fund (PECF) solar generation will be integrated into the grid in 2016 and 2017, when the grid stability issues are resolved. It is projected that around 5% of the total generation will be from solar PV installed from the EDF10 project and the percentage share of renewable energy will increase to 12.42% when the PECF project comes on line.

2 51.7 kWp from EDF9, 89 kWp from the EDF10 Project and 202.4 kWp from PECF project. The PECF project only allows 110 kW of installed capacity to be generated to the grid as the 92.4 is used for charging the battery.

Table 2 provides the total diesel and solar PV grid-connected system installed capacities and the peak demand from 2009 to 2014.

Table 2: Total installed diesel capacity and solar PV capacity

Year	Total diesel installed capacity (kW)	Total solar installed capacity (kW)	Peak demand (kW)
2009	2032	0	512
2010	2084 ¹	51.7	559
2011	2084	51.7	551
2012	2084	51.7	590
2013	2084	51.7	590 (estimate)
2014	2084	343.1	590 (estimate)

Source: Niue Power Corporation 2015

The electricity generation statistics for diesel and solar PV, including the percentage of renewable energy share, are provided in Table 3.

Table 3: Total generation diesel and solar 2009–2014

Year	Diesel generation/kWh	Solar PV generation/kWh	Total generation / kWh	Fuel used / litres	kWh / litre	% RE share
2009	2876885	0	2876885	669885	4.29	0.00%
2010	3081197	66828	3148025	755986	4.08	2.13%
2011	3201148	68717	3269865	842003	3.80	2.18%
2012	3264508	64470	3328978	790685	4.13	1.97%
2013	3285240	66672 (estimate)	3351912	825541	3.98	2.00%
2014	3160219	66672 (estimate)	3226891	839038	3.77	1.99%

Source: Niue Power Corporation 2015

3.2 Peak demand

The projected peak demand for Niue will also increase in the next ten years, as shown in Figure 6. The peak demand is captured as capacity requirement. Capacity requirement captures the peak demand on business as usual and the reserved demand. The reserved demand is all the expected load from the growth in tourism, returning residents, construction of planned buildings by government, the use of electric vehicles, and improved infrastructure, such as schools and accommodation for tourists.

³ One diesel gen-set was replaced, increasing the diesel installed capacity.

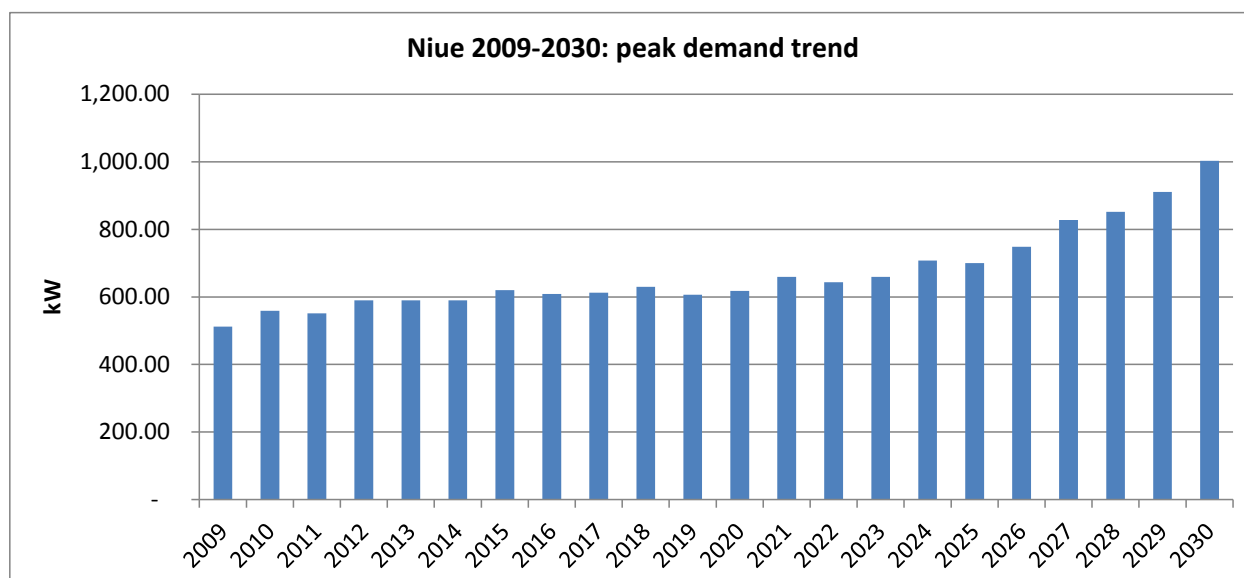


Figure 6: Annual peak demand actual and projections from 2010–2030

3.3 Grid improvement and energy storage

In mid-2012, the GoN through funding support from the Pacific Islands Greenhouse Gas Abatement through Renewable Energy Project (PIGGAREP) engaged DNV KEMA, a global energy consultancy company, to investigate technical issues around the stability of the existing power system and the effect of the planned solar PV systems on stability. The Dynamic Power Study report stressed that the grid stability issue has been going on a long time, with the use of only one diesel gen-set and the starting of two big electricity users: the quarry crusher motor (50 kW) and the wharf winch motor (11 kW). The crusher motor, in particular, seriously affected the Niue power system stability as it caused a severe drop in system voltage and frequency, which in turn caused the existing solar plants to trip off-line, both at the high school and hospital. Running two diesel units helps, but the frequency dip may be severe enough to risk losing the solar generation.

Other causes of instability mentioned in the study report are the fluctuations in solar generator output and voltage that can have a significant impact on electric system operations and stability, especially as solar generator penetration increases.

The study report made four recommendations.

- Diesel generation must provide the frequency and voltage reference for any future PV installations.
- As the inverters used with solar generation are susceptible to low-voltage drop-out during certain extreme events, the voltage ride-through for the inverters should be reduced to low voltage set point for the 0.20–2.0 period from 0.65 to 0.50 pu. All existing and future inverters should use these settings.
- Shunt reactance of 130 kVar (inductive) should be fitted to counteract the capacitive effect of the cable network. Installation of three 65 kVar reactors was recommended.
- All the prospective (future) cases showed that one diesel gen-set should handle normal renewable output variations.

The power sector in Niue urgently requires technical assistance to support implementation of the recommendations from the KEMA study. This will solve the grid instability issues and allow Niue to integrate more renewable energy generation. The New Zealand Ministry of Foreign Affairs and Trade (MFAT) is providing financial support for a qualified technical advisor to work closely with the Utilities Department and the NPC to fast-track the recommendations from the study

and provide technical skills as required.

3.4 Renewable energy potential

Niue has the potential to exploit some renewable energy sources such as solar, wind, wave energy, ocean thermal energy conversion, biomass and biogas. There is no significant tidal, geothermal or hydro energy resources. The only significant renewable energy sources currently used in Niue are solar PV and to some extent wood (biomass) for traditional cooking, and solar thermal energy for water heating.

3.4.1 Solar energy potential

The 2004 PIREP³ study reported an average of 4.52 kWh/m²/day for Niue. The University of the South Pacific (USP)/Korea International Cooperation Agency project set up two masts for wind and solar data monitoring but the data had not been analysed before the write-up of this road map.

Solar energy is the best option to meeting the renewable energy target, but work on stabilising the national grid is required to allow maximum penetration of solar energy. In addition, due to the intermittent characteristics of solar energy, energy storage is required to save energy that can be used at night time. The total installed solar PV capacity of 343.1 kW could contribute around 5% of solar generation to the electricity generation, assuming the grid instability issue is resolved and battery storage is available.

3.4.2 Wind energy potential

Wind energy has been proposed in the past, but it did not result in any installation on the ground. Niue's modest power requirements could be met by three or four turbines to supplement diesel generation. No significant negative impacts on the environment or social problems seem likely from the use of wind power. However, any turbines installed must be designed to survive cyclones and must be carefully integrated into the grid to avoid instability problems.

The wind option could be looked at for the long-term benefits of meeting the renewable energy targets, reducing the use of fossil fuel, and realising GoN commitments towards climate change. For the benefit of future decision making Table 4 provides information on the status of wind energy use in other Pacific Island countries.

Table 4: Wind energy status in some selected Pacific Island countries

Country	Capacity of turbine installed (kW)	Number of turbines	Total capacity installed	Supplier	Wind energy contribution to the grid
Vanuatu	275	11	3.025 MW ⁵	Vergnet	1.2%
Fiji	275	37	10.175 MW	Vergnet	2%
Samoa	275	2	550kW	Vergnet	2%

Source: SPC 2015

³ megawatts

After further data collection and analysis, wind energy may also be shown to be a cost-effective option and if this is the case, it can be integrated into the renewable energy target mix in the future.

3.4.3 Other renewable energy technologies

3.4.3.1 Biomass

Biomass resources may not be a good option for Niue, given the poor soil and the need for conservation of existing forest resources. Coconut oil for biofuel maybe possible but is unlikely to be cost-effective because of limited labour and human resources on the island.

3.4.3.2 Biogas

Biogas captured through a biogas digester at Vaipapahi Farm could be developed and demonstrated. A four cubic metre biogas digester may be possible with at least ten mature pigs to be available at all times.

3.4.3.3 Ocean energy

Niue has a mean wave energy flux of around 16.49 kW/m and this is ideal for grid connection. However, the Pacific region has not had any experience of wave energy technology and this may not be an option until the distant future, ten to twenty years from now.

3.5 Energy efficiency and conservation potential

3.5.1 Electricity supply losses

A study of the Niue power system energy losses conducted by KEMA in 2012 quantified the losses into two categories: *station losses*, which were categorised as efficiency of generating units and power plant auxiliary loads and *distribution station losses – technical and non-technical*.

This section discusses the findings of the study on the NPC power system total losses of 11.86% consisting of:

- 5.19% in power station auxiliaries (station losses), which is relatively high;
- 4.7% in technical losses, which is in the normal range;
- 0.03% in non-technical losses, which is an excellent level; and
- 1.94% in unbilled usage for street lights and a portion of the consumption by the water system.

The power station losses of 5.19% is high and ideally should be reduced to 4% or lower. The study highlighted some unaccounted losses from the NPC buildings at the power plant site, street lights and two nearby houses. The KEMA study report recommendations are considered in the implementation plan of this road map. For non-technical losses, the KEMA report recommends that replacement of older meters by new meters is a priority and is included in this road map. In order to achieve better and more accurate figures on total losses and non-technical losses, it was also recommended to perform monthly meter readings on or around the last day of the month in order to get a more accurate comparison between energy entering into the feeders and energy sold.

3.5.2 Residential, commercial and government

The 2004 Pacific Islands Renewable Energy Project study estimated a 10% savings on electricity demand could be achieved through demand side management (DSM) activities in the residential, government and commercial sectors. These activities include consumer awareness on energy conservation and promoting financial incentives for consumers to use more efficient appliances.

In order to determine the electricity usage for the three sectors, electricity sales data were collected from the Treasury Department. However, the data do not provide a breakdown of the different sectors since the residential and commercial sales are lumped together as private, while the government is recorded as public. There is a need to increase awareness and understanding of data recording and analysis as the three sectors have different usages and therefore should be dealt with differently.

In order to get an estimate on electricity use for the three sectors, private sector consumption is divided thus: 40% for residential users and 60% for the commercial sector. This is used to estimate the baseline electricity uses for residential and commercial users. Figure 7 depicts the electricity billed for the residential, commercial and government users.

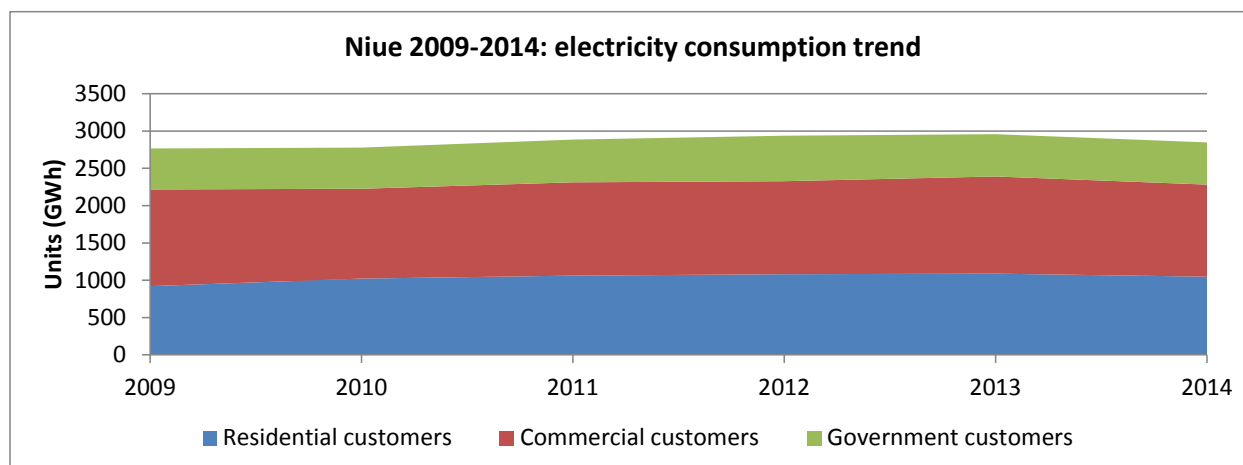


Figure 7: Electricity consumption trend 2009 to 2014

Source: SPC, 2015

Residential sector

Energy efficiency strategies that could be adopted for the residential sectors could include;

- an energy efficiency lighting strategy;
- air conditioners retrofit in government buildings;
- appliance standards and labelling; and
- an LPG rehabilitation programme.

Tables 5 and 6 show what energy savings⁴ could be achieved through an energy lighting strategy and air conditioners retrofits.

Table 5: Energy savings through lighting strategy

	No. of projects	kWh/yr saving	USD/yr saved	CO ₂ t/yr emission savings
Street lighting projects	11	334058	\$185,343	286
Residential lighting projects	6	1317635	\$614,787	1139
Commercial and public sector	9	1315945	\$603,631	972
	26	2967638	\$1,403,761	2397

Source: PEEP 2 <http://www.ee-pacific.net/>

Table 6: Energy savings through AC retrofit⁵

	No. of units replaced	kWh/month saving	USD/month saved	CO ₂ t/yr emission savings
High efficiency (EER 3 to 4) inverter air conditioners	11	4,500	\$2,160.00	2397
	11	4500	\$2,160.00	2397

Source: RMI Energy Audit Nick Wardrop presentation case study, Feb 2012

3.5.3 The commercial sector

The high electricity consumers are the Swanson Supermarket and the Matavai Resort. The NPC reported that the commercial sector had carried out their energy audits as they are quite keen to reduce electricity consumption. However, there is a need for aggressive awareness-raising on energy efficiency and energy conservation.

3.5.4 The government sector

There is a need to collect and monitor energy usage in all government buildings in order to establish baseline data, and track consumption on an ongoing basis, mainly those buildings using air conditioning units. The energy efficiency measures could be incorporated into revised building codes and supported by financial incentives for buildings that incorporate renewable energy uses, such as solar water heaters, gas stoves, efficient lights and energy labels on electric appliances.

3.5.5 The tourism sector

Tourism has gradually increased in Niue since 2009. Visitor earnings have also increased, reaching more than NZD 5 million in 2013, and will continue to rise as GoN has committed to increase its investments in the extension of the Matavai resort in order to accommodate the larger number of visitors to Niue.

However the number of tourists and visitors to Niue will affect electricity generation, electricity consumption, transportation and water pumping. Even though water is free and not metered to households and hotels, electricity is used to pump water to the water tank or reservoir.

There should be an aggressive awareness on electricity uses as well as water conservation.

⁶ Using past projects such as the PEEP 2, RMI EE experiences

⁵ There are 22 households with Air conditioning Units

3.5.6 Appliance labelling and standards

Niue has no approved standards on electrical appliances and this road map considers the benefits of participating in the Pacific Appliance and Labelling Standards (PALS) project that will provide funding and technical assistance for a review of legislation to establish standards and labels for selected household appliances, including lights, freezers/refrigeration and air conditioners. An energy efficiency study conducted by SPC in 2012 concluded that an effective labelling programme in Niue could result in annual savings of approximately 173.4 mega-watts hour (MWh) of electricity and 189 tons of CO₂ emissions. The savings in avoided electricity is USD 60,000 over the ten year period.⁶

3.5.7 LPG rehabilitation

LPG use for cooking was promoted in the EDF9 project, with distribution of 314 gas stoves at the end of the project in December 2010. There has since been a reduction in the total consumption of LPG in Niue for households from 69% in 2012 to 60% in 2013 and reduced to 55% in 2014. However the commercial sector experienced increased use of LPG. Table 7 highlighted the estimated trend on the LPG consumption for the two sectors, residential and commercial.

Table 7: Total consumption (GJ) of LPG per sector 2010–2014

	2010	%	2011	%	2012	%	2013	%	2014	%
Residential, community and social services	818.19	69	898.06	69	978.06	69	924.09	60	891.27	55
Commercial	365.22	31	400.87	31	436.58	31	626.76	40	737.10	45
Total consumption	1183.41	100	1298.92	100	1414.64	100	1550.84	100	1628.37	100

Two issues contributed to the slow uptake of LPG: i) the high cost of LPG compared to electricity and ii) reports that the distributed LPG stoves were not working due to faults in the gas pipe and there being no spare parts available on the island. The gas pipes need to be replaced with the commonly used fittings, which requires funding and technical expertise that can be provided by the NBF (Niue Bulk Fuel).

The 2011 census reported that 116 households out of the 477 used electricity for cooking and 320 used gas stoves, but about half of these stopped using LPG shortly after take-up. This road map aims to convert them, as well as the existing 116 households that use electricity, to LPG as the main means of cooking. In total, the goal is to have 276 households converted to LPG for cooking.

3.6 Electricity sub-sector targets

The road map has identified priorities that will reduce the burden on government spending on power generation. *First* is to implement the actions required to fully utilise the total capacity of the solar energy installed, hence the need to resolve the grid in-stability issues and *second*, is to improve both the efficiency of electricity generation supply and the demand use of electricity.

⁶ 68,899 litres of diesel avoided over a ten year period.

Table 8 summarises the targets relating to the priorities for reducing diesel use for electricity production through increased percentage share of renewable energy and reducing electricity consumption through supply and demand side efficiency.

Table 8: Electricity sub-sector goals and targets

	Base year	2017	2020	2025
Goal 1: Significant renewable energy integrated to the grid				
Indicator 1: Percentage of renewable energy of total generation	2% (2009)	5%	50%	80%
Goal 2a: Improve efficiency in the electricity sub-sector				
Indicator 1: Percentage of electricity savings through supply side management programme	5.19% (2011)	4.9%	4.5%	4%
Indicator 2: Fuel efficiency (kWh/litre) remains constant in 2017	3.77 (2014)	4.0 kWh/l	4.0 kWh/l	4.0 kWh/l
Indicator 3: Percentage of total billed electricity consumption reduced			10%	15%
Indicator 4: Percentage of households using LPG for cooking fuel	67% (2011)	34% (2015 estimates)	57%	90%

Transport sub-sector



Transport sub-sector

4.1 Transport energy use

In 2014, the transport sector was estimated to account for 71% of the total fuel energy consumption on Niue. Of this, over 99% of the fuel consumed in the transport sector is for land transportation. Kerosene sales for aviation are accounted as international sales and are reflected as re-export figures for Niue.

The graph presented in Figure 8 represents the energy consumption for the transport sector 2009 to 2014.

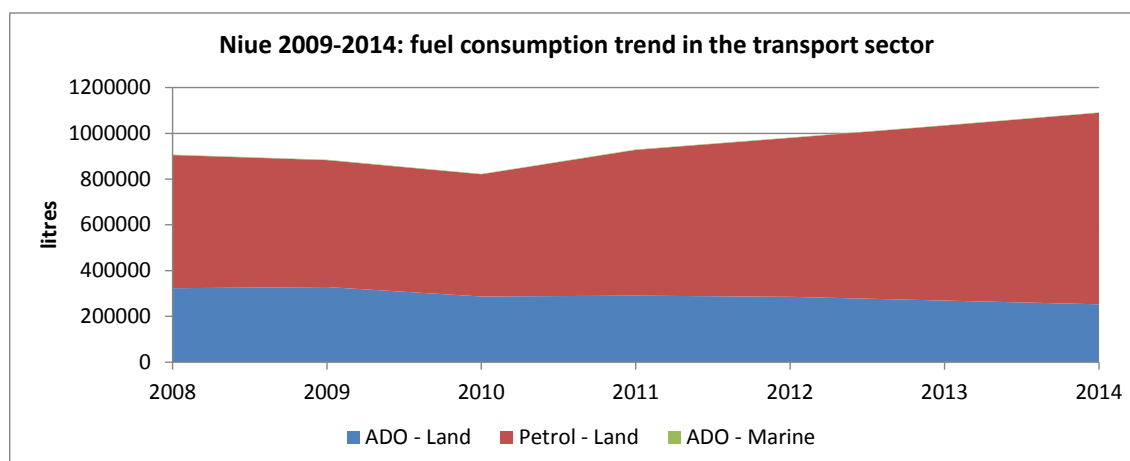


Figure 8: Fuel use for transport sector 2009 to 2014

Source: SPC data 2015

4.2 Land transport

The *Transport Act 1965* and regulations govern the licensing and related fees for motor vehicles use in Niue. The 2011 census recorded a total of 926 vehicles at household level, estimating that, on average, every household⁸ in Niue owns at least two vehicles. The availability of loans and second-hand cars from relatives living abroad are two of the reasons for the increased number of vehicles.

A regulation developed under the *Customs Tariff Act 1982* restricts the importation of second-hand cars that were manufactured before 2000 as they are less fuel-efficient than the latest models.

The mode of transport to work as surveyed in the 2011 census report was by motor vehicles.⁹ There is no public transport system in Niue and therefore a private vehicle is the predominant form of transport for workers and the public. The census report noted that 77.1% of employers use their own vehicle to travel to work, even in those areas where the government offices are situated around Alofi South and Alofi North. Only 13.3% of workers said they shared a vehicle when they travelled to and from work and this is common for those who come from Vaiea, Avatele, Likue and Tuapa, villages further away from government buildings. In terms of fuel, petrol is the fuel most used for land transport.

4.3 Transport sub-sector targets

There have been no activities relating to energy efficiency and renewable energy options for the transport sector in the past, and the road map will constitute the first effort to examine

⁸ In 2011, there were 477 households in Niue.

⁹ In 2011, there were 555 motor cars, 96 vans or trucks, 23 motorbikes and 46 bicycles.

this area. As the majority of fuel use is for land transport and the other major user of fuel is the airline industry where international regulations limit the scope for national interventions, the road map will focus on land transport.

The target for land transport is shown in Table 11.

Table 9: Land transport target

	2009	2015	2020
Goal 2b: Improve efficiency in the transport sub-sector			
Indicator 1: Percentage of fuel efficient vehicles – solar battery powered, hybrid or engine cylinder capacity of less than 1300	No data	No data	1% (50 vehicles)

Options to improve efficiency in land transportation include the following.

- In 2011, Customs regulations were amended to encourage the import of fuel-efficient vehicles into Niue. For example, the following tiers are applied to vehicles:
 - 10% duty** for spark-ignition internal combustion reciprocating piston engines, cylinder capacity not exceeding 1500 cubic centimeter (cc) **OR** compression-ignition internal combustion piston engines (diesel or semi-diesel) for transport of goods (of a gvw not exceeding 5 tonnes)
 - 20% duty** for spark-ignition internal combustion reciprocating piston engines cylinder capacity exceeding 1500 cc but not exceeding 3000 cc **OR** compression-ignition internal combustion piston engines (diesel or semi-diesel) for transport of goods (of a gvw exceeding 5 tonnes but not exceeding 20 tonnes)
 - 40% duty** for spark-ignition internal combustion reciprocating piston engines cylinder capacity exceeding 3000 cc **OR** compression-ignition internal combustion piston engines (diesel or semi-diesel) for transport of goods (of a gvw. exceeding 20 tonnes)
 - Vehicles: electrical, self-propelled, (not fitted with lifting or handling equipment) of the type used for short distance transport of goods in factories, warehouses, dock areas or airports have 0% duty.
- As technology improves, the Customs regulations need to be reviewed and adjusted at regular intervals (i.e. every five years) to support fuel-efficient vehicle import initiatives. Customs have confirmed a new tariff has been proposed and will be implemented once approved by Cabinet.
- Vehicle types must be considered and classified for this plan moving forward – for example the average family car sufficient to transport parents to work and children to school should aim to have an engine cylinder capacity of less than 1300 cc rather than a heavy duty utility vehicle for towing a fishing boat or for gathering firewood from the plantation, etc. This could have an engine cylinder capacity up to 2500 cc.
- Provide incentives and facilities to improve the quality of maintenance of vehicles.
- Consider incentives to increase the use of bicycles and promote health as a way of preventing non-communicable diseases.

An electric-diesel hybrid vehicle may be an option to investigate for the near future as the power generation is currently supplying more than the energy demand. The batteries can be charged using electricity, thereby reducing the use of diesel fuel. As renewable energy generation increases, the feasibility of fully electric vehicles with solar (or wind) charging can be a good option for a low carbon economy. However, fully electric vehicles are far from becoming a commercial reality in practice, even worldwide. A preliminary investigation into the benefits and costs of electric vehicles would be needed before any concrete steps are taken in this direction.

Petroleum sub-sector



Petroleum sub-sector

5.1 Fuel supply and demand

Niue Bulk Fuel (NBF) imports and distributes petroleum products in Niue. There is only one retailer for automotive diesel oil (ADO) and petrol, while LPG is distributed by the private sector – Ali’s enterprise. Fuel supply to Niue is provided through Matson shipping, which procures fuel from Z⁷ energy of New Zealand. Maintenance and inspection of systems is based on industry standards published by Shell. Several of the larger tanks at Sir Robert’s wharf are currently in poor condition and not up to industrial standards, but these assets are not currently required due to the tank-tainer supply model. Key spare parts for pumping and treatment systems are held on the island. The current method of fuel importation is through tank-tainers, but recent investigations have looked into restoring the local coastal tankers supply model, including the Alofi wharf bulk fuel tanks.

NBF assets currently in use include storage tanks at Amanau and Hanan Airport, tankers, pumps, hoses and the jet fuel distribution line (including filtration systems, etc.). In addition to these assets, there are storage tanks at Sir Robert’s Wharf in Alofi that were damaged in cyclone Heta in 2004. Total petroleum imports to Niue in past years average around 2.4 million litres per annum. Diesel is the largest volume imported to Niue, averaging 1.2 million litres per annum. The electricity generation diesel use accounts for 66% of the total imports (0.8 million litres).

Figure 9 provides the NBF projections that predict an increase in fuel demand in all types of fuel; ADO, petrol, dual purpose kerosene (DPK) and LPG until 2016. However, diesel use for power generation is expected to decrease after 2016 following the planned increase in the renewable energy share to the total generation. Jet fuel or DPK imports are also expected to increase in the coming years, noting the growth in the tourism sector that will eventuate with more than two flights per week to Niue in the foreseeable future. LPG use will also increase once it is readily accessible and becomes more affordable compared to electricity.

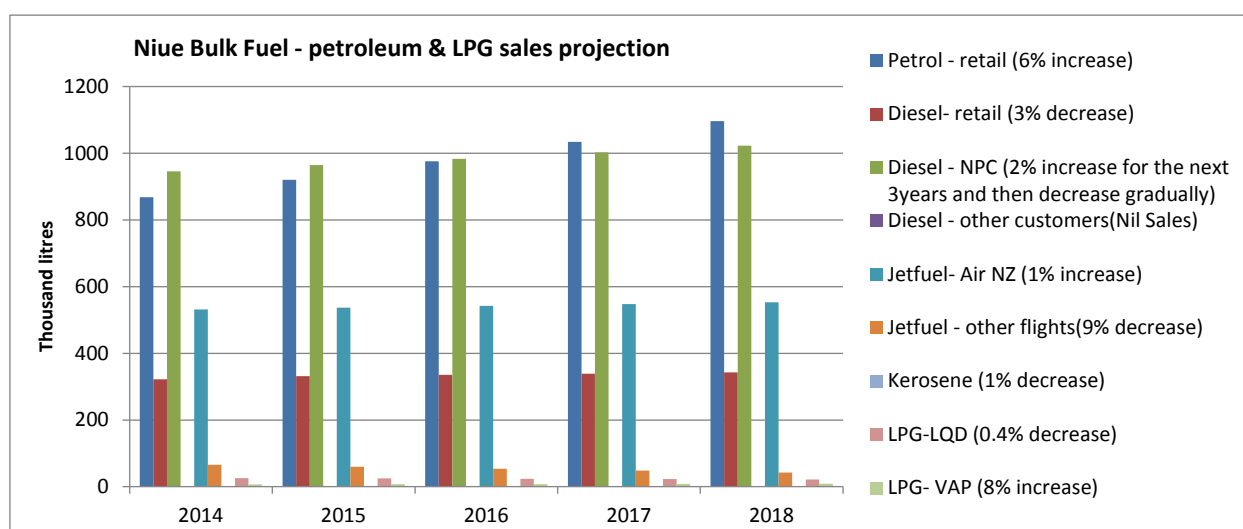


Figure 9: Petroleum fuel and LPG sales projects 2015–2018

Source: NBF presentation 19 Nov 2014

7 Z Energy was formerly Shell

Other departments involved in fuel supply include:

- Department of Transport – Responsible for the unloading of bulk fuel from freight vessels and transport to tank- tainer transfer sites and service stations.
- Treasury – Responsible for ensuring that sufficient government funds are available to cover the cost of bulk fuel purchase from the international market.

NBF has a number of guiding policies in place that address safety and accidents. These include:

1. National response plan
2. Oil spill response
3. Fire hazard

Niue is one of the countries in the region that uses high quality fuel for both power generation and land transport of 10 parts per million (ppm) sulphur content in diesel and 91 Research Octane Number (RON) for petrol. LPG imported into Niue is a mix of propane and butane. The comparison of the fuel quality imported into other Pacific Island countries compared to Niue is provided in Table 9 below.

Table 10: Pacific region fuel quality

Pacific Island country or territory	Current Fuel Quality				
	Diesel fuel for land transport max sulphur (ppm)	Diesel fuel for power generation max sulphur (ppm)	RON	DPK (aviation and household)	LPG
American Samoa	10	10 and 500	92	DPK	Butane
Cook Islands	10	500	95	DPK	Butane and Propane 60:40 mix
Fiji	500	High-sulfur fuel oil (HSFO) and 500	92	DPK	Butane
French Polynesia	50	Marine diesel oil >2% sulphur	95	DPK	Butane
Guam	10	HSFO and 10	92	DPK	Butane
Kiribati	500	500	92	DPK	Butane
Republic of the Marshall Islands	500	500	92	DPK	Propane
Nauru	500	500	92	DPK	Propane
New Caledonia	10	HSFO and 10	95	DPK	Butane
Niue	10	10	91	DPK	Butane/Propane mix 60:40
Palau	50	50	92	DPK	Butane
Papua New Guinea	500	500	92	DPK	Butane
Samoa	500	500	92	DPK	Propane

Solomon Islands	500	500	92	DPK	Propane
Tonga	500	500	92	DPK	Butane
Tuvalu	500	500	92	DPK	Butane
Vanuatu	10	500	95	DPK	Propane
Wallis and Futuna	10	10	95	DPK	Butane

Source: SPC 2015

5.2 Fuel pricing

Fuel retail prices are monitored by government through the NBF and there is no active fuel pricing control mechanism in place. Fuel sale and taxation is an income for government. There are various levies included in the wholesale selling prices of fuels, such as the 0.06 cents a litre on diesel, petrol and aviation fuel to cover the cost of renting the tank-tainers from the fuel suppliers.

A fuel price change in Niue is carried out on an ad hoc basis by the NBF and is influenced by either a major surge or fall in international market prices. The fuel price for ADO, petrol and DPK has remained the same since March 2013. Prices for LPG were significantly higher than other similar sized markets in the region, as seen in Figure 9. One of the reasons for the higher cost of LPG in Niue is that LPG is imported in 45 kg cylinders rather than in bulk supply using a 20-foot ISO tanktainer. Once on the island, the LPG is transferred to 9 kg cylinders to sell to the public. The monitoring of fuel and LPG prices can be introduced within the *Price Control on Imported Goods for Resale in Niue Act 1975*, which is currently being managed through a board.

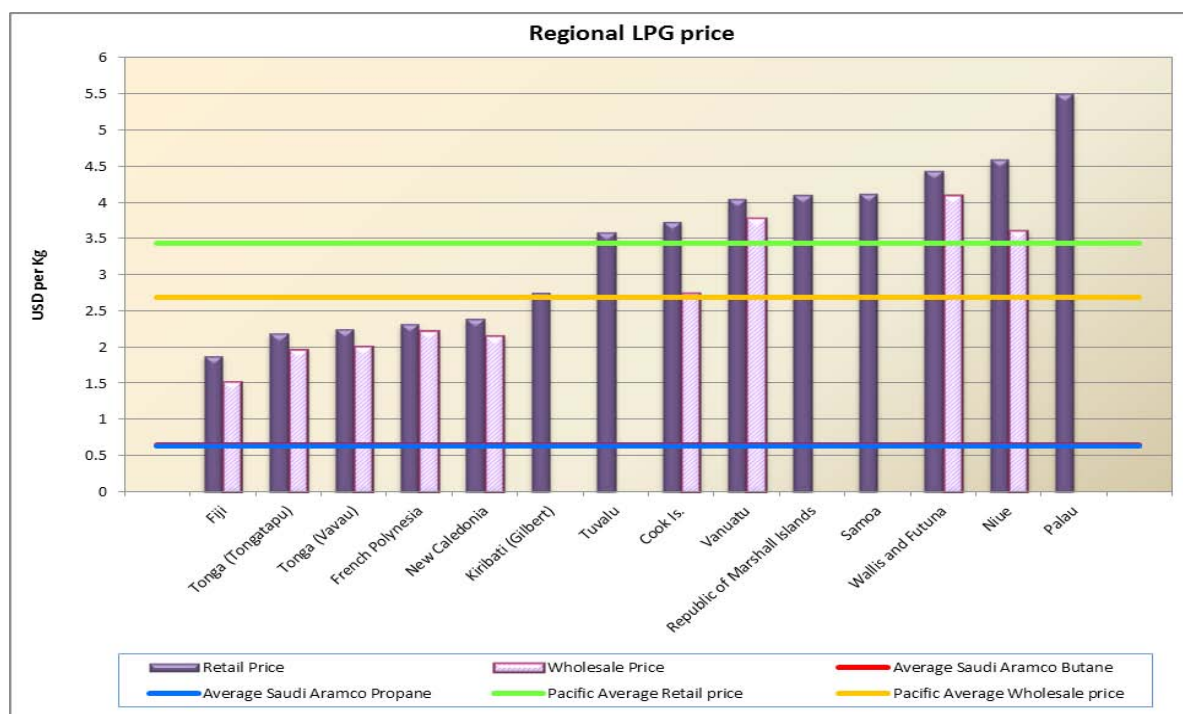


Figure 10: Regional prices of LPG (including tax and duty)

Source: SPC 2015

5.3 Petroleum sub-sector targets

This section of the road map highlights the security of petroleum supply essential for continued economic growth and social development in Niue. It also highlights the need for improving the affordability of petroleum products mainly for industrial and commercial activities through cost-effective options for supply and storage of fuels. The current practice of importing diesel is perceived as an expensive way to supply fuel, as the tank rental is charged per litre of total imports. There are at least 11 tanks kept on the island at any one time. LPG imports are also imported in 45 kg cylinders, which are more expensive compared to bulk import in isotainers. However, with the anticipated increased use of LPG for households and for the commercial and possibility transport sector, the road map proposes the revamping of the LPG infrastructure to provide safe and secure storage sites for LPG. Table 10 presents the goal and targets for the petroleum sub-sector.

Table 11: Petroleum sub-sector targets

	2015	2016	2020
Goal 3: Reliable energy supply			
Indicator 1: Fuel supply security days (no. of days).	28	50	60
Indicator 2: Percentage of the average forced outage to below the regional average of 5.4%.		5.4	5.4
Indicator 3: Average outage duration for each customer served – SAIDI (minutes)		200	200

5.4 Achieving government leadership and commitment

The GoN understands the need to balance the capital investments for establishing the proper fuel storage facility that will increase the fuel security of supply, with potential consequential increase in fuel prices to fund the capital investments. The GoN has imposed various levies on petroleum products through the *Niue Consumption Act 2009* and the *Customs Tariff Act 1982*. There may be a need to include a fuel tariff for capital investments on the rehabilitation of the fuel storage tank and LPG revamping infrastructure.

The proposed measures described in this section will contribute to achieving the energy sector goal of reliable energy supply in Niue.

- Undertake a comparative study on the economics on fuel import using tank-tainer versus the local coastal tankers.
- Undertake a comparative study on the economics of LPG imports using ISO LPG tank containers compared to 45 LPG cylinders.
- Strengthen the price monitoring of petrol, diesel, kerosene and LPG.
- Increase the fuel supply security days so that Niue is not affected by irregular shipping schedules.
- Strengthen the energy infrastructure so that it is more resilient to natural disasters.

Policies



Policies to sustainable energy opportunities in Niue

Niue has a National Energy Plan and Action Plan endorsed by the Government of Niue in 2005. The *Niue Electric Power Supply Act 1960* governs the supply and distribution of electricity in Niue. The Transport (Annual License Fees) Regulation 1991 and 2007 developed under the *Niue Transport Act 1965* and currently administered by the Police Department, regulates annual license fees for motor vehicles.

There is no legislation that clarifies the roles of government in terms of planning, developing, and coordinating energy initiatives, energy sector regulation and creating a market where private sector and community stakeholders can engage effectively, for example, in the introduction of net-metering, which may facilitate incentives to promote the installation of grid-connected household solar energy systems. The establishment of an energy unit under the Department of Utilities will be skilled in planning and regulation of the energy sector. The development of an energy act was proposed to help regulate the energy sector and encourage private sector participation

Niue has made commitments to low-carbon development, including being signatory to the Kyoto Protocol of the UNFCCC. Its Second National Communication is being developed and the Draft National Strategy Plan 2015 highlights the commitments to having a zero carbon economy by 2020. Niue has pledged targets for renewable energy in the Majuro Declaration (100% share in the overall energy mix by 2020). The target is very ambitious and is being revised in this NiSERM to 80% renewable energy share for power generation by 2025. The policies, legislation and financial barriers to meeting this target are discussed in the next chapter. Niue is a new member of the International Renewable Energy Agency, which, as part of its Small Island Development States Initiative, will provide technical assessments on Niue's readiness to deploy renewables and transition the electricity sector from fossil fuel to renewable energy.

6.1 Concrete policies and measures

6.1.1 Encouraging and improving energy efficiency

The Niue Chamber of Commerce represents the business community interest and has functioned well in the past with 115 members. It is a member of the Pacific Islands Private Sector Organisation. The *2014–2019 Niue National Strategic Plan* has included private sector development as a new pillar to national development, recognising the contribution of the private sector to the economy of Niue. The Chamber of Commerce recently provided financial support of NZD 4,000 per member to assist with small business development, including the uptake of more efficient appliances. However, legislation relating to the use of energy efficient appliance labelling and standards, as well as fiscal incentives such as less import duty, is non-existent in Niue. The development of legislation and awareness-raising on the benefits of adopting energy labels and standards is important to the public and communities. Complementing the financial scheme of the Chamber of Commerce and other financing institutions is the SPC Pacific Appliance and Labelling Standards (PALS) project, which assists in the review of legislation relating to electric appliance labels and standards. The Ministry of Infrastructure is to send SPC a request to participate in the PALS programme. The Low Carbon Islands Project of the Global Environment Facility Pacific Alliance for Sustainability – implemented by the UN Environment Programme and executed by the International Union for Conservation of Nature (IUCN) Oceania Regional Office – has started discussions with the Kiwi Bank and the Niue Development Bank (managed by Niue Commercial Enterprises Ltd) to establish an energy efficiency loan scheme that will also support the uptake of energy efficient appliances.

6.1.2 Incentivising renewable energy deployment

The Government of Niue has not put in place any of the elements required to support a transition to a sustainable energy system; the existing solar farms were put in place by aid development. There are no tax or financial incentives promoting renewable energy use by private or individual users. Importation of solar photovoltaic (PV) systems is taxed at normal rate of 12.5% and there is no feed-in tariff for some of the private solar installations that exist on the island. A new 5 kW system was installed in 2015 at the Stone Villa cottage that will demonstrate the use of solar energy in the tourism sector, and even though it is grid-connected, there is no reward for the excess energy integrated to the grid. Another private house has installed a 5kW solar system for its own use and there is no incentive to connect the system to the grid. However, as mentioned, the first priority is for NPC to work on its grid stability issue prior to allowing more solar PV grid connections.

6.1.3 Training and capacity building

Technical assistance and capacity building are required to reduce the technical, administrative, legal and political barriers to promoting renewable energy deployment and encouraging energy efficiency. Niue, like other PICTs has limited resources and capacity to overcome barriers and there is also limited opportunity for human resources development.

Technical barriers that were highlighted in the KEMA 2012 grid stability assessment study, the PIREP report and Crawley's (2014) report:

- the lack of maintenance of the PV systems, which may contribute to the declining output;
- the need for more training on maintenance and operation, and trouble shooting of the PV systems at the NPC;
- maintenance and repair work on the electricity transmission lines around the island;
- experience from the PECF project with limited training and the need for more training and trouble shooting; and
- lack of electricity data collection and analysis.

Barriers to policy implementation and evaluation is a challenge, due to the absence of local technical know-how to implement and evaluate the energy policy in general and the limited humans resources dedicated to energy planning.

Technical assistance and capacity building should focus on:

- policy design for policy makers, including feed-in tariff design, price and rate setting, as well as roadmap/policy/legislative review and transitional decreasing of financial support to the utilities over time;
- development, resource assessment and feasibility studies for government and local and bilateral partners;
- grid expansion and stability management, and integration strategies for the NPC;
- assessing the establishment of private or foreign investors in order to support the increase uptake of solar PV systems and energy efficient appliances; and
- technical assessment of renewable energy technology – wind, biomass and biogas.

Implementation of this road map is important and is supported by technical assistance (TA) as Niue has limited human resources and capacity. The New Zealand Ministry of Foreign Affairs and Trade is providing funding support for TA on road map implementation, prioritising grid stability management and operational support activities. The funding support is available for a period of two to four years.

6.1.4 Data collection and analysis

This road map provides recommendations on improving data collection and analysis to inform decision makers.

Electricity data

- Generation data should include all required parameters, including peak demand load.
- Electricity data generated into the grid from all solar farms should be consistently recorded.
- Electricity sales data should be segregated into three categories: residential, business/industry/commercial, and government. This should be aligned to the different electricity tariffs for each sector.
- Recording of outages data is important to monitor the actual demand forecast.

Energy efficiency data

- There are limited data available on energy efficiency and conservation. However, for future policy analysis the following needs to be done.
- Electricity bills should be recorded and the records readily available.
- Record the number of electrical appliances in all government buildings and their power usages (watts). Office equipment registries should include power (watts) use.
- Maintenance officers should keep a record of the number of lights, the type of lights, as well as the energy or power wattages installed in government buildings, and estimate the power usages for each building.
- Government buildings should have meters; energy usage should be recorded and electricity use should be monitored.
- Census reports should include all electrical appliances in residences, including freezers and refrigerators. The number of freezers/refrigerators was not included in the 2011 census record.

NiSERM financing plan



NiSERM financing plan

Financial savings analysis

The GoN stands to gain significant short to long-term financial savings from implementing this road map. The chief priority should be the stabilisation of the grid to maximise the contribution of solar generation to the grid, which, when complemented by the purchase of a more effective solar battery, will address key generation and distribution issues. Stabilisation of the grid will reduce the need to use the large diesel generator to supplement electricity generation during peak use, which translates into diesel savings. Grid stabilisation will also avert potential costs that will be incurred if the drop in system voltage and frequency during peak use is severe enough to result in the loss of the solar system all together. Once grid stabilisation takes place, there should be increasing prospects to progressively substitute renewable energy sources (solar) for fossil-based fuel as the main generation source for electricity in Niue. This should result in cost savings to the country in terms of savings from a reduction in the government fossil fuel bill for electricity generation and production and consumer subsidies paid by the government.

Savings from full solar penetration will be equivalent to the diesel generation cost equivalent of the current 'unused' kWh solar generation capacity. Approximately 2% of the 342 kWp of solar energy generated is integrated into the grid, as at 2014, with 335.16 kWp of 'unused' solar generation. In 2012, Niue expended NZD 6 million on 2.45 million litres of petroleum imports; diesel for electricity generation was about 0.83 million litres (about 34% of the total) at a cost of about NZD 2.02 million. With diesel generation in the same year at 3,264,508 kWh and the NZD 2.02 million spent on diesel-based electricity generation, the fuel cost per kWh diesel generation is about NZD 0.62. The 64,470 kWh solar energy generated in 2012 is equivalent to NZD 39,966, which is the estimated annual savings the GoN can expect to get just from improved solar energy utilisation in the electricity grid (accounting for fuel price changes and any improvements in generation efficiency that could have taken place between 2012 and 2015). KEMA reports that substantial reduction of technical losses (transmission and distribution) of 4.7% through the introduction of two shunt reactors (more than 50% lower) would save 75,000 kWh per year of technical losses, representing a value of NZD 27,750.

In 2013 Niue expended NZD 6 million on 2.3 million litres of petroleum imports. Diesel for electricity generation was about 0.8 million litres (about 25% of the total) at a cost of about NZD 1.5 million. This amount stands to increase in the short term as tourism-led growth and immigration of Niuean retiree families from New Zealand expand, and it is envisaged that the electricity grid will be stabilised before 2018.¹⁰ Niue targets 80% renewable energy generation by 2025, ten years from now. Based on current expenditure, Niue can expect to save about NZD 1.2 million over the next ten years. However, savings will occur incrementally until the renewable energy target is met, as follows: 5% in 2015, 50% by 2020, and 80% by 2025. This implies that the average annual rate of increased solar penetration is 9% during 2015 to 2020 and 6% during 2020 to 2025. On this basis, assuming there is no major change (increase) in the price of petroleum, the savings from the reduction in diesel purchase should follow a similar trend. Incremental savings annually of about NZD 75,000 in 2015, NZD 167,000 per year during the period 2015–2020 and NZD 58,000 per year during the period 2020–2025 can be expected.

¹⁰ NZMFAT is providing financial support for a technical advisor to work with NPC to solve the grid stability issue, management of the electricity generation, transmission and distribution.

Electricity consumption is subsidised in Niue, with subsidies of between 75% and 80% of the true recovery cost, costing the government NZD 3.3 million subsidy bill in 2014. This has been an attempt by the GoN to bridge the ‘affordability gap’, but remains a huge burden on the government’s budget. Electricity tariffs in Niue have a three -tier rate structure that is applicable to all the customers as follows - NZD 0.50 per kWh for the first 100 kWh/month of usage, NZD 0.60 per kWh for usage from 101 to 300kWh/month and NZD 0.70 per kWh for usage over 300 kWh/month. However, due to high electricity consumption across the country, virtually all customers receive tier 3 electricity tariff rates. The true recovery cost of electricity has been estimated at NZD 2.70. The existing tariff rates do not recover the cost of providing electricity services, requiring the government to provide subsidies averaging NZD 2 million (in 2013) or more annually in subsidised electricity billing rates to the power utility (NPC). The total billed electricity consumption (from diesel generation) in 2014 was 2843213 kWh, and at a 74% subsidy rate, the government paid about NZD 1,949,130 in subsidies to NPC in the same year. In addition, NBF receives about NZD 1.3 million annually in subsidies¹¹ to improve access to imported fuel for other end users such as transport, quarrying and mining, agriculture, forestry and fisheries.

Although these subsidies are provided to improve the access to and affordability of energy, given the high cost of fuel imports for power generation, these subsidies are a huge burden on the GoN budget and divert resources from perhaps more important and productive investments. As Niue achieves its renewable energy target, which will reduce the per-unit cost of generation, along with improved grid stabilisation, there will be less need to subsidise electricity. Given the high cost of diesel-based electricity generation in Niue, the government stands to make considerable savings from the removal of these subsidies. In 2014, the government provided a subsidy of NZD 2,019,000 on 3,226,890 kWh of electricity generated, resulting in a subsidy per kWh of electricity generated of NZD 0.63/kWh, based on a 98% diesel generation and a 1.99% solar generation mix in the same year. By 2025, the target is to achieve 80% solar generation and 20% diesel generation. As Niue achieves its renewable energy target, the annual subsidy amount provided by the government as shown in Figure 11 should reduce in proportion to the reduction in diesel imports. Since the volume of diesel use for electricity generation is estimated to decrease from 98% to 20% (approximately 80% decrease) between 2014 and 2025, as solar generation increases from a baseline of 20% in 2014 to 80% in 2025, this should result in a proportional decrease in subsidy per kWh equivalent to NZD 0.13/kWh by 2025 (a NZD 0.50/kWh subsidy reduction). In monetary terms, the total government subsidy bill should bottom out to about NZD 488,883 by 2025. This translates into savings of NZD 1,530,116 between 2014 and 2025.

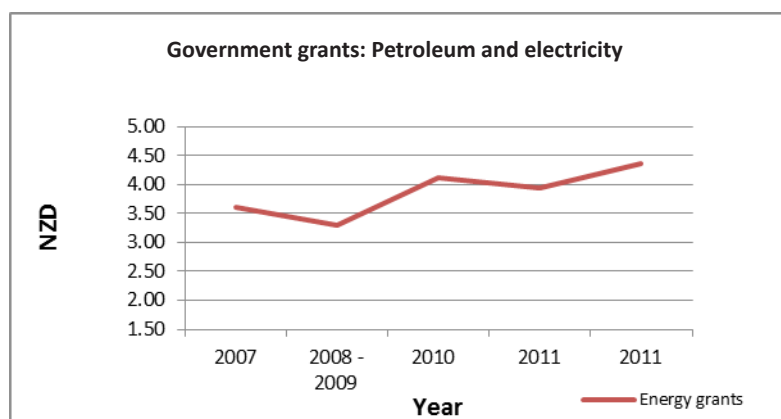


Figure 11: GoN energy grants (subsidies)

Source : 2014 Appropriation Act (see original)

11 The subsidies paid to NBC are not considered in this analysis; subsidy reductions will occur as each of these industries (transport, quarrying and mining, agriculture, forestry and fisheries, etc.) each reduce their reliance on fossil fuels, undertake energy efficiency initiatives/actions and adopt renewable energy technologies.

More effective bill collection will result in an initial savings of around NZD 500,000, for the GoN from outstanding unpaid bills at the end of 2014. Improving compliance through more effective bill collection may require hiring bill collectors to implement penal measures such as disconnecting electricity supply of users for non-payment with reconnection contingent on payment of current and overdue bills. The cost of this compliance strategy will be insignificant in comparison to additional cash inflow from unpaid bills. Depending on whether the faulty meters around the country are over-reading or under-reading, they could deter users from paying their bills where they are overcharged, but could also be costly to the government if the meter readings result in under-charging of consumers. While it is not clear if there are potential savings from the meter repair, the government stands to make some savings from unpaid bills that resulted from this issue (and potentially revenue gains if the meters are indeed under-reading) once the cost of repairing these meters has been accounted for.

As part of the road map, the GoN will undertake a number of programmes to improve energy efficiency in the commercial and residential sectors. These should further reduce the national energy demand and at the same time result in savings for consumers. Programmes include: energy efficient lighting and appliance introduction and LPG rehabilitation programme. These programmes will reduce the demand for electricity and will be underpinned by a public awareness and education programme. In terms of the LPG rehabilitation programme, 314 LPG cooking stoves were installed in 2008–2009, bringing the total number of LPG users in Niue to 320 households. However, about half of these households stopped using LPG shortly after take-up. The target of this road map is to convert this half of the current 320 users plus the existing 116. However about half of these households have stopped using LPG to date and have switched back to electricity for cooking, households that use electricity as the main means of cooking to LPG. In total, the goal is to have 276 households converted to LPG for cooking. According to the REP-5 final report, during the initial electricity-LPG conversion period in 2008–2009, Niue recorded a savings of 46,000 litres of diesel directly attributable to the installation of the LPG stoves under the REP-5 project. This is equivalent to a 5% saving in relation to annual consumption, with potential savings expecting to be around 220,000 litres per year, assuming LPG demand peaks at 60 tons a year. Using these assumptions, if Niue expects savings of 220,000 litres of diesel a year from 320 households' uptake of LPG, the GoN should expect savings of about 189,750 litres of diesel from the conversion of 276 households to LPG. At the diesel wholesale price to NPC of NZD 1.27 a litre, this is equivalent to approximately NZD 241,500 in annual savings.

Additionally, an SPC (2012) energy efficiency study estimates annual savings from an effective appliance labelling programme alone of 173.4 MWh of electricity, and savings from avoided electricity of about USD 600,000 over a ten-year period, or about USD 60,000 annually. The Pacific Islands Renewable Energy Project report has estimated a 10% savings on electricity demand could be achieved through demand side energy efficiency at the residential, government and commercial electricity users. This amount equates to an 80,000 litres reduction in diesel imported annually for a savings of NZD 150,000. This should also accelerate the rate of reduction of sectoral subsidies. Niue's total electricity use per capita is about 1500 kWh/year, which represents a per capita expenditure of NZD 900.00. Assuming a 10% reduction in electricity demand, a per capita savings of NZD 90.00 can be expected. If the average household size in Niue is four (NZ Statistics 2015) this infers an annual savings of NZD 360.00 per household, which should incentivise them to reduce their energy consumption. Conservation strategies should target the largest electricity consumers – the government – and the main commercial users.

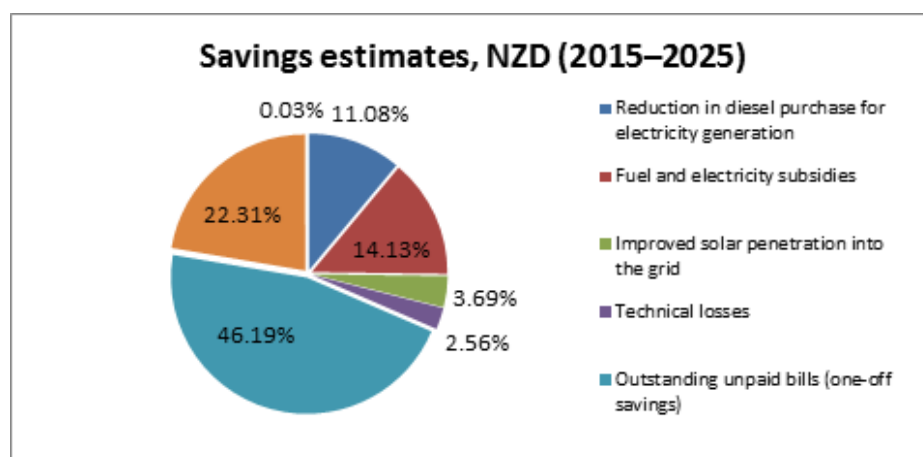


Figure 12: Savings estimates

A cost-benefit analysis (CBA) of fuel supply and storage options will be undertaken as part of the road map to determine the cost-effectiveness of current procurement arrangements, compared with rehabilitation of storage facilities damaged by cyclone Heta in 2004. This should result in savings from efficiency gains from bulk purchasing that will allow for negotiation of lower prices, which should be quantified during the CBA. Bulk purchase of LPG will also result in a significant decrease in purchase costs of LPG, that will not only benefit the GoN through lower energy bill, but will also benefit households through a lower cost of cooking. As it stands, due to the purchase of LPG in small 45 kg cylinders, Niue faces one of the highest costs of LPG in the region, which is one of the deterrents to the quick uptake of LPG as a substitute for electricity for cooking. In the absence of the CBA, it should be noted, however, that as the rate of renewable energy penetration increases, the need for extensive fuel storage facilities will be lessened.

GoN plans to offer economic incentives to promote renewable energy uptake and adoption of energy efficiency measures. Based on experiences of other PICTs, these measures are integral to promoting renewable energy and energy efficiency savings estimated above. Furthermore, GoN as part of its leadership responsibility, should take the lead in improving the energy efficiency of public buildings. Improved maintenance of the electricity generation system should also result in further savings, which should also be quantified. Table 12 provides estimates on potential savings when meeting the renewable energy and energy efficiency targets.

Table 12: Potential savings breakdown

	Annual savings, NZD (2015 – 2025)
Reduction in diesel purchase for electricity generation	≈ NZD 120,000 (NZD 1.2 million over 10 years)
Fuel and electricity subsidies	≈ NZD 153,000 (NZD 1,530,116 over 10 years)
Improved solar penetration into the grid	NZD 39,966
Technical losses	NZD 27,750
Outstanding unpaid bills (one-off savings)	≈ NZD 500,000
Conversion to LPG	NZD 241,500
Reduction in electricity demand – energy efficiency initiatives (per household)	NZD 360

7.2 Financing the road map

Niue has been a recipient of international and regional funding in past years. The estimated funding from 2004 to 2014 was around USD 8 million dollars from development partners, mainly from the European Development Fund (EDF), New Zealand Ministry of Foreign Affairs and Trade (NZMFAT), Japanese International Cooperation Agency (JICA) and regional agencies. However for the next ten years, the following investments presented in Table 13 are required to implement the NiSERM.

Table 13: NiSERM estimated investment

Goals and strategies	Cost (NZD)	Secured (identified under existing programmes)	Unsecured	Possible donors for unsecured funds
Goal 1: Significant renewable energy (RE) integrated to the grid				
Strategy 1.1: Grid stability issues resolved	730,000	250,000 (NZ-MFAT)	480,000	GoN
Strategy 1.2: Investigation and implementation of RE resources to meeting the RE target	29,125,000	20,000 (GoN) 620,000 (EDF11)	28,485,00	SIDS DOCK, United Arab Emirates JICA, NZMFAT EDF11
Strategy 1.3: Build in-country capacity to operate and maintain renewable energy technologies	210,000	110,000 (SPC PACTVET)	100,000	IUCN, USP Fulbright specialist programme
Sub-total Goal 1	30,065,000	1,000,000	29,065,000	
Goal 2: Improve energy efficiency (EE) in the electricity and transport sub-sectors				
Strategy 2.1: Reduce NPC station and technical losses – this activity relates to Strategy 1.1	185,000	20,000 (GoN and EDF11)	165,000	
Strategy 2.2: Reduce NPC non-technical losses	725,000	0	725,000	GoN
Strategy 2.3: Capacity development on EE and auditing	55,000		55,000	GEF - 6
Strategy 2.4: Introduce and regulate energy efficient labels and standard	100,000	40,000 (SPC-PALS)	60,000	GEF - 6
Strategy 2.5: An effective institutional and regulatory framework for energy sector including EE	90,000	10,000 (Low Carbon Project)	80,000	

Strategy 2.6: Investigate cleaner fuel for land transport	66,000		66,000	GEF 6
Strategy 2.7: Replace electricity use with LPG for cooking	100,000		100,000	
Strategy 2.8: Improve EE in water sector	1,500,000	73,000 (GoN, EDF10)	1,427,000	
Sub-total Goal 2	2,821,000	143,000	2,678,000	
Goal 3: Reliable energy supply				
Strategy 3.1: Efficient fuel and LPG supply and storage logistics	375,000	25,000 (SPC)	350,000	GoN
Strategy 3.2 Reduce interruptions to the power	2,000,000	150,000 NZ-MFAT 60,000 GoN 530,000 EDF10 ³	1,319,940	
Strategy 3.3 Improve resilience to the energy infrastructure	6,300,000		6,300,000	GoN
Sub-total Goal 3	8,675,000	705,060	7,969,940	
TOTAL INVESTMENT	41,561,000	1,848,060	39,712,94	

NiSERM implementation framework

7.2 Roles and responsibilities

Implementation of the NiSERM requires collaboration and commitment across the public sector, complemented by strong support from the private sector, local communities and development partners.

A proposed implementation structure is illustrated in Figure 13. Currently, the MOI coordinates the energy sector but it is only mandated to provide support and advice to the power sector and the land transport sector. Fuel imports and pricing are housed under the commercial and trading arm of government in the Premier’s Office. However, for road map implementation, there are new structures that are important to effect; the NiSERM Steering Committee is to pull together the relevant stakeholders to advise and progress the road map. The GoN is streamlining all project implementation through the Project Management and Coordination Unit (PMCU). Therefore, the NiSERM Steering Committee will include a representative from the PMCU who can report on the progress of the NiSERM to development partners.

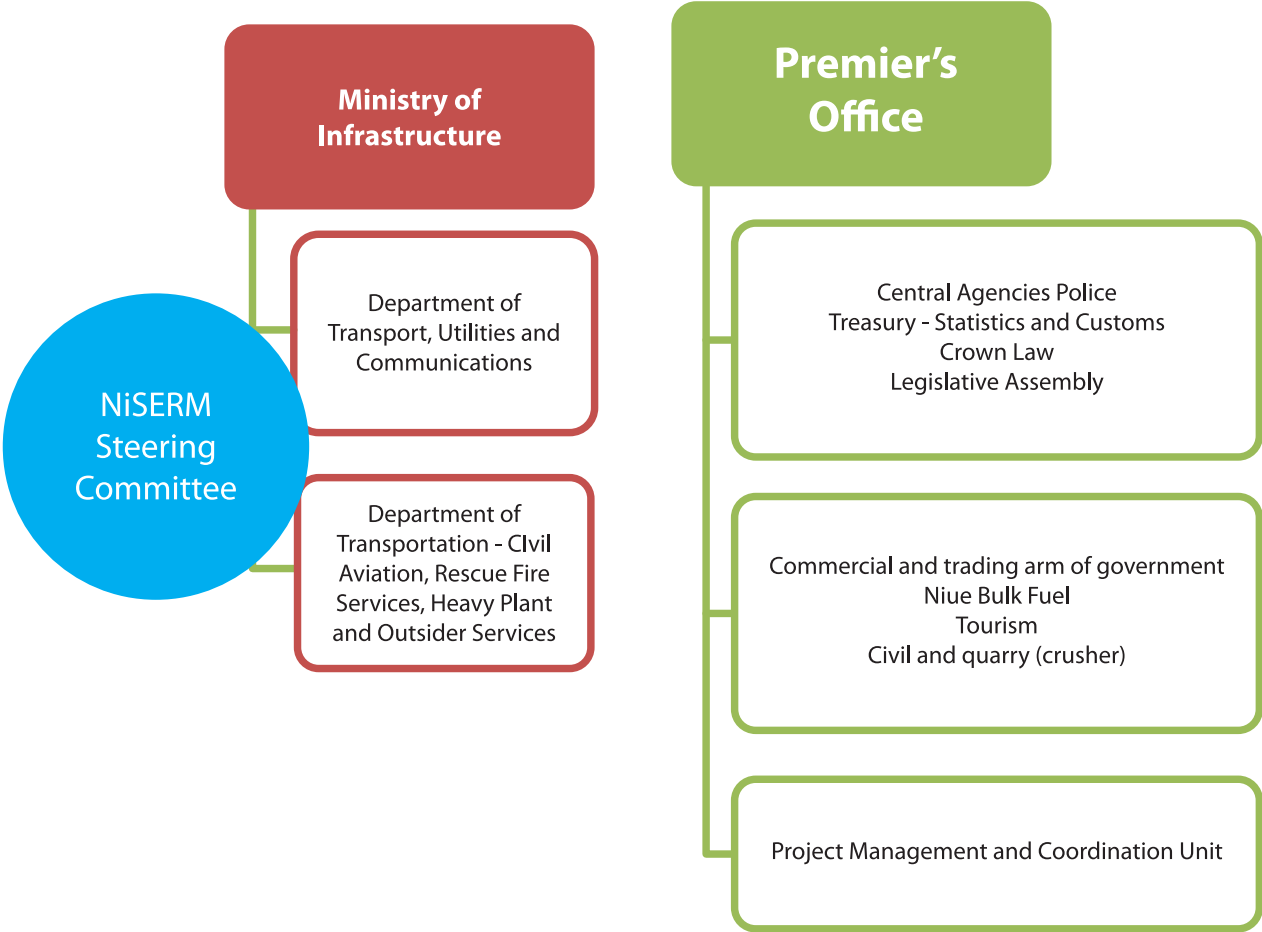


Figure 13: Road map implementation institutional framework

Monitoring and evaluation plan



NiSERM monitoring and evaluation plan

8.1 Monitoring

The Monitoring Plan is attached as Annex 4. It provides a guide to monitor the progress of the NiSERM over its lifespan of ten years. The plan has been developed in conjunction with the MOI, the NPC and NBF and other relevant stakeholders.

For the purpose of this road map, the United Nations Development Programme definition of monitoring is applied: *an ongoing process by which stakeholders obtain regular feedback on the progress being made towards achieving their goals and objectives* (UNDP 2009).

The development of the monitoring plan was guided by the following principles.

- 1) Virtual usefulness: that it should remain useful now and into the foreseeable future.
- 2) Simplicity and clarity: that it be simple and clear enough for its application and should reflect the relative smallness of Niue, including the energy sector.
- 3) Enabling and enforceable: that it will strengthen government's ability to track its progress and assess the efficiency with which it is implemented, and the effectiveness of its intended impact on peoples' lives.
- 4) Evidence-based: that it provides a tractable and sound basis for the government's continued development planning purposes.
- 5) Transparency and accountability: that it enhances transparency and accountability.
- 6) Practicality – including using indicators for which data can be collected on a timely basis and at a reasonable cost.

8.2 Evaluation¹²

An external evaluation will be taken at the mid-term juncture (2017–2018) to provide an independent assessment of what has been achieved and the progress on achieving the targets. However, availability of information and accessibility of primary and secondary data are still required to conduct effective evaluation of the road map progress and we hope that data collection will be a continuous activity.

¹² Evaluation can be defined as a '...rigorous and independent assessment of either completed or ongoing activities to determine the extent to which they are achieving stated objectives and contributing to decision making' (UNDP, p. 8, 2009). The key distinction between monitoring and evaluation is that evaluations are done independently to provide managers and staff with an objective assessment of whether or not they are on track. Evaluations are also more rigorous in their procedures, design and methodology, and generally involve more extensive analysis. However, the aims of both monitoring and evaluation are similar: to provide information that can help inform decisions, improve performance and achieve planned results (UNDP, p. 9, 2009).

Annexes



Annexes

Annex 1: People and organisations consulted

<p>Ministry of Infrastructure Andre Siohane Director General</p> <p>Utilities Department Deve Talagi Director of Utilities</p> <p>Transport Department Sonya Talagi Director of Transport</p> <p>Niue Power Corporation Speedo Hetutu Power Manager</p> <p>Warren Halatau HV Cable Advisor</p> <p>Hui Paola Leading Hand</p> <p>Thirdson Akeimo Leading Hand</p> <p>Kerrie Mautama Accounts/Admin Officer</p>	<p>Premier's Office Richard Hipa Permanent Secretary</p> <p>Christine Ioane Acting Permanent Secretary Director for Parliament Services</p> <p>Treasury Department Doreen Siataga Treasury Accountant</p> <p>Christabel Kaukasi Talagi Budget Reports</p> <p>Kimray Vaha Statistician Statistics Office</p> <p>Project Management and Coordination Unit Angela Tuhipa Establishment Director</p> <p>Vilnus Talagi Project Support Officer</p>	<p>Commercial and trading arms of government George Valiana General Manager Niue Bulk Fuel</p> <p>Private Sector <i>Niue USP Campus</i> Maryannne Talagi Director</p> <p>Tau Poumale Librarian</p> <p><i>Chamber of Commerce</i></p> <p>Felicity Bollen Business Development Manager</p> <p>Gabriel Varea Business Support Officer</p> <p><i>Niue Tourism</i> Vanessa Marsh Tourism Development Coordinator</p>	<p>Development partners</p> <p>New Zealand High Commission in Niue Ross Ardern High Commissioner</p> <p>Jenna Priore Deputy Head of Mission/ First Secretary</p> <p>IUCN Andrew Irvin Energy Programme Officer</p> <p>SPC – Economic Development Division</p> <p>Solomone Fifita Deputy Director - Energy Programme</p> <p>Frank Vukikomoala Energy Database Officer</p> <p>Koin Etuati Energy Policy Officer</p> <p>Delton Jones Economic Advisor</p> <p>Uchenna Onuzo Energy and Transport Economist</p> <p>Alan Bartmanovich Petroleum Advisor</p> <p>Rupeni Mario Team Leader, North Pacific Regional Office</p>
---	--	---	---

Annex 2: References

Crawley Warren	2014	Niue Island Power System Investigation – An investigation into the impact of high levels of renewable energy into a diesel power electricity grid and determination of optimization solutions, February 2014; Palmerstone North, New Zealand
Government of Niue	2012	Niue Census of Population and Households, 2011, Statistics Niue, Department of Finance, Planning and Statistics, Government of Niue
	2015	Draft Niue National Strategy Plan 2014–2019, unpublished
Herbert Wade	2012	Challenges for Renewable Energy Integration in the Pacific Islands Grids Presentation, Vanuatu, 15 July 2012
	2004	Pacific Regional Energy Assessment 2004, Niue National Report Volume 8, Secretariat of the Pacific Regional Environment Programme (SPREP)
	2013	Pacific Lighthouses - Renewable energy opportunities and challenges in the Pacific Islands Region: Niue, August 2013
Niue Power Corporation	2012	Niue Dynamic Stability Study – Integrating Renewable Energy
Pacific Power Association	2012	Quantification of the Power System Energy Losses in Southern Pacific Utilities – Consolidated Report,
	2011	Performance Benchmarking for Pacific Power Utilities – Benchmarking Report, December 2011
	2012	Quantification of the Power System Energy Losses in South Pacific Utilities – Niue Power Corporation, prepared by KEMA, May 30 2012
Secretariat of the Pacific Community	2011	The costs and benefits of introducing standards and labels for electrical appliances in Pacific Island Countries
	2012	Niue Country Energy Security Indicator Profile 2009
United Nations Development Programme	2009	Handbook on Planning, Monitoring and Evaluating for Development Results
IT Power	2010	Support to the Energy Sector in Five ACP Pacific Islands (REP-5), Programme Management Unit, Pacific Islands Forum Secretariat European Union – 9 th EDF,

Annex 3: Niue energy balance

Niue energy balance in gigajoules (GJ) 2009–2015

TOTAL PRIMARY ENERGY SUPPLY	2009	2010	2011	2012	2013	2014	2015
Production	548	788	795	780	788	788	787
Solar PV	0	241	247	232	240	240	240
Solar hot water systems	16	16	16	16	16	16	16
Biomass	532	532	532	532	532	532	532
Imports	86465	77964	86756	90237	100005	102683	105303
ADO	45668	42183	46172	47716	49696	48936	49848
Petrol	20193	19478	23069	25071	27525	30050	31853
Kerosene	19276	15120	16217	16036	21233	22070	22006
LPG	1328	1183	1299	1415	1551	1628	1597
Exports	19220	15072	16156	15915	21211	22001	21937
Kerosene (international flights)	19220	15072	16156	15915	21211	22001	21937
International marine bunkers	0	0	0	0	0	0	0
Stock changes	0	0	0	0	0	0	0
Total primary energy supply	67793	63680	71396	75102	79582	81470	84154

TRANSFORMATION	2009	2010	2011	2012	2013	2014	2015
Oil to electricity generation	18225	16982	20354	21922	24633	25125	25257
ADO	29523	28074	31879	33674	36460	36502	37225
Electricity generation from diesel	-11298	-11092	-11524	-11752	-11827	-11377	-11967
Own use and losses	1339	1332	1384	1410	1419	1366	1436
Electricity	1339	1332	1384	1410	1419	1366	1436

Net Supply	48229	45366	49658	51771	53529	54980	57461
------------	-------	-------	-------	-------	-------	-------	-------

FINAL ENERGY CONSUMPTION, in GJ	2009	2010	2011	2012	2013	2014	2015
Industry and government	4599	4277	4392	4527	4173	4073	4207
ADO	2583	2257	2287	2247	2118	1989	2020
Kerosene	39	34	43	85	15	48	48
Electricity	1978	1986	2063	2195	2040	2036	2139
Transport	31940	29628	33331	35118	36916	38783	40726
ADO - Land	12671	11075	11221	11023	10391	9757	9910
ADO - Water	81	71	71	70	66	62	63
Petrol - Land	19189	18482	22039	24025	26459	28964	30754
Residential, community and social services	5610	5870	6095	6257	6195	6026	6173
Petrol	810	809	807	803	798	793	789
Kerosene	17	14	18	36	7	21	21
LPG	918	818	898	978	924	891	852
Electricity	3316	3681	3823	3892	3919	3773	3964
Renewable energy – heating and cooking	548	548	548	548	548	547	547
Commercial	5402	4982	5189	5205	5581	5433	5665
ADO	327	282	286	281	265	253	252
LPG	410	365	401	437	627	737	744
Electricity	4665	4334	4502	4487	4689	4443	4668
Agriculture, forestry and fishing	678	610	651	664	664	665	689
ADO (Bulldozers)	484	423	429	421	397	373	379
Petrol - Fishing	194	187	223	243	267	293	311
Total final energy consumption	48229	45366	49658	51771	53529	54980	57461

Annex 4: NISERM monitoring plan

GOALS	INDICATORS	RELEVANT TARGETS	MEANS OF VERIFICATION	RISKS AND ASSUMPTIONS
Goal 1: Significant renewable energy integrated to the grid	Indicator 1: Percentage of renewable energy in total generation	80% by 2025	NPC generation log sheets Solar sites data (SMA) NPC Annual Report NPC Benchmarking Report	Financial and technical capacity Political support

Strategy 1.1: Grid stability issues resolved

Activities	Organisation responsible	Activity - Importance	Time frame	Expected outputs/results	Estimate cost NZD
Activity 1.1.1: Implementation of the recommendations of the dynamic grid stability, including the purchase of three 65 kVAR shunt reactors: one connected to the power plant site and one connected to each feeder (see page 26 of the grid stability report).	MOI – DOU/NPC	Very high	1 year	Grid stability issue is resolved	150,000
Activity 1.1.2 Replacement of 50 distribution transformers units to reduce losses.	MOI	Very high	3 Year	Grid stability issues	550,000.
Activity 1.1.3 Procurement and installation of meters to monitor power generation from solar PV connected to the grid and savings on fossil fuel use. Three solar sites (hospital, airport, college) are not visible at the power station.	MOI – DOU/NPC	High	1–5 years	Data from solar PV versus diesel use analyses	15,000
Activity 1.1.4 Carry out a tariff study and provide a true recovery cost on electricity once grid instability is resolved.	MOI – DOU/NPC	Very high	Every year	Tariff study available	30,000

Strategy 1.2: Investigation and implementation of renewable energy resources to meet renewable energy targets						
Activities	Organisation Responsible (supporting organisations)	Activity - Importance	Time frame	Expected outputs/ results	Estimated cost NZD	
Activity 1.2.1: A projection of around 3175 kW is required to meet the 80% renewable energy target by 2025 (assuming grid stability is resolved by 2016–2017)	MOI/DOU-NPC	High	5–10 years	Increased % share of renewable energy in total generation	28,900,000 ⁴	
Activity 1.2.2: TA review the <i>Electric Power Supply Act 1960</i> to regulate the NZAS 3000 standards and the SEA/PI and PPA standards for solar PV on-grid and off-grid standards (for donors and private investors compliance)	MOI/DOU-NPC	High	1 year	Solar PV standards adopted	20,000	
Activity 1.2.3: Undertake consolidated renewable energy assessments for power generation and transport and other uses.	MOI/DOU-NPC	High	3 years	Wind Assessment Report available (USP data analysed)	30,000	
Activity 1.2.4: Demonstration of stand-alone system off-grid at 5 houses for 5 kW and explore policy mechanisms to incentivise renewable energy deployment.	MOI/DOU-NPC	High	3 years	Five decentralised solar PV systems in place	100,000	
Activity 1.2.5: Explore the potential for solar PV and wind options grid-connected for water pumping and designing and access to funding opportunities.	Water Department MOI	Low	3 years	Design and funding proposals completed	50,000	
Activity 1.2.6: Construction of a 4 cubic metre biogas digester at the Vaipapahi Farm – decentralised off-grid for own power use	DAFF	Medium	3 years	Funding proposal and design specifications available	10,000	

Strategy 1.3: Build in-country capacity to operate and maintain renewable energy technologies						
Activities	Organisation responsible (supporting organisations)	Activity - Importance	Time-frame	Expected outputs/ results	Estimated cost NZD	
Activity 1.3.1: Develop and implement accredited training programme on the renewable energy technologies installations, maintenance and operations, mainly for solar.	SPC/USP PACTVET SPREP/JICA, Others	High	1 year	Local persons capable of installing and O and M of solar plants	30,000	
Activity 1.3.2: South-South collaboration exchange programme and attachment in other PICTs or New Zealand	SPC, PPA, USP, Fulbright Specialist Programme	High	2 to 3 years	At least 6 NPC staff attended attachment training by 2025	30,000	
Activity 1.3.3: Establish scholarships for engineering undergraduate studies in tertiary institutions.	NPC, development partners, private sector	High	10 years	At least six student study RE and engineering by 2030 in tertiary institutions	150,000	

EXPECTED GOAL AND ACTIVITIES	INDICATORS	RELEVANT TARGETS	MEANS OF VERIFICATION	RISKS AND ASSUMPTIONS
Goal 2: Improve energy efficiency in the electricity and transport sectors.	Indicator 1: Percentage of electricity savings through supply side management programme	4.5% by 2020	Generation log sheets Data analysis reports	Data collection and analysis not updated
	Indicator 2: Fuel efficiency (kWh/litre) remains constant in 2017	4.29 kWh/litre in 2017	Generation log sheets Data analysis reports	Financial resources Management and supervision
	Indicator 3: Percentage of total billed electricity consumption reduced	10% by 2020	Sales data Meter reading data Generation log sheets	Data collection and analysis not updated
	Indicator 4: Percentage of households use LPG as cooking fuel	90% by 2025	Census reports on household use for cooking	Social barriers Financial and political resources
	Indicator 5: Percentage of fuel-efficient vehicles (solar battery powered, hybrid or engine cylinder capacity of less than 1300cc)	1% by 2020	Vehicle registration data	Financial and political resources

Strategy 2.1.7 Reduce NPC Station and Technical losses						
Activities	Organisation Responsible (supporting organisations)	Activity - Importance	Time frame	Expected outputs/ results	Estimated cost NZD	
Activity 2.1.1.1: Carry out an energy audit of the power station and implement efficiency measures (Current station power loss is 5.19%), recommendation to bring down to below 4% (KEMA report pg. 20)	MOI/DOU-NPC	Very high	3 to 5 years	NPC stations loss maintained at 4%	10,000	
Activity 2.1.1.2: Develop a plan for installing reduced distribution transformers (KEMA report 2012 pg 26)	MOI/DOU-NPC	Very high	1 year	Distribution transformer core loss accounts for 48.31% of technical losses, which should be reduced	60,000	
Activity 2.1.1.3: Procurement and installation of three shunt reactors required to reduce the technical losses (KEMA 2012 pg 27)	MOI/DOU-NPC	Very high	1 year	Technical losses reduced by 50%	100,000	
Activity 2.1.1.4: Include meter readings of the feeder bays in the power station log sheets in order to separate the station losses from the distribution losses (KEMA 2012, pg 28)	MOI/DOU-NPC	High	6 months	Actual station losses identified	15,000	
Strategy 2.2: Reduce NPC non-technical losses						
Activities	Organisation Responsible (supporting organisations)	Activity - Importance	Time frame	Expected outputs/ results	Estimated cost NZD	
Activity 2.2.1: Monitor street light and sea track light usage and replace to LED. 300 street lights available on the island.	MOI/DOU-NPC	High	2 years	Energy efficient lights retrofit Reduced electricity consumption/losses	115,000	

Activity 2.2.2: NPC to perform the monthly meter readings around the mid-month to get a more accurate comparison between energy entering into the feeders and energy sold.	Treasury Department	Very high	1 year	Accurate meter readings recorded	10,000
Activity 2.2.3: Pre-payment meters installed for households/government – 850 meters (2015) to 900 in 2020.	MOI/DOU-NPC	Very high	3 years	900 prepayment meters installed and institutional structure established for managing prepayment meters	600,000

Strategy 2.3: Capacity development on energy efficiency and conservation

Activities	Organisation Responsible (supporting organisations)	Activity - Importance	Time-frame	Expected outputs/results	Estimated cost NZD
Activity 2.3.1: Establish an energy unit within the Utilities Department. ⁵	Premier's Office, MOI	High	3 months	An Energy Efficiency Officer (EEO) is recruited	15,000
Activity 2.3.2: Carry out energy audits at the two largest commercial customers, Matawai Resort and Swanson Supermarket, and others. ⁶	MOI-DOU-NPC, TA	High	3 months	TOR for TA developed and recruited. Energy audit training delivered	30,000
Activity 2.3.3: Undertake energy surveys/audits of government buildings and provide least-cost options.	MOI - DOU - NPC	Very high	6 months	Energy audits carried out Savings on electricity for government	10,000

Strategy 2.4: Introduce and regulate energy labels and standards

Activities	Organisation Responsible (supporting organisations)	Activity - Importance	Time-frame	Expected outputs/results	Estimated cost NZD

Activity 2.4.1: Conduct a study on the formulation of legislation on appliance labelling and standards and how it should be enforced.	SPC – PALS, MOI – DOU, Crown Law Office	High	1 year	Niue to register interest in the PALS project, regulations on PALS formulated	20,000
Activity 2.4.2: Carry out awareness raising to communities, businesses and government.	SPC – PALS, MOI – DOE	High	Ongoing for 3 years	Communities, businesses and government are aware of energy labeling	30,000
Activity 2.4.3: Prepare and enact appropriate legislation for energy labelling and MEPS.	Crown Law Office, Premier's Office, MOI – DOU	High	2 to 3 years	Legislation enacted	20,000
Activity 2.4.4: Training for customs and other government departments on labelling and MEPS, including enforcement.	SPC – PALS, MOI-DOU, Premier's Office	High	2 years and ongoing	Customs and other government departments trained	10,000

Strategy 2.5: An effective institutional and regulatory framework for the energy sector

Activities	Organisation Responsible (supporting organisations)	Activity – Importance	Time-frame	Expected outputs/ results	Estimated cost NZD
Activity 2.5.1: Propose the formulation of an energy act to include regulations on energy sub-sectors – Petroleum, EE and RE	MOI-DOU, Crown Office	High	5 years	Energy act passed through parliament	40,000
Activity 2.5.2: Assess the establishment of a regulatory authority to monitor and develop an efficient transport sector, including the private sector. ⁷	MOI – DOT/NBF/ Police/ Customs	High	1 year	Assessment available that monitors fuel use for transport sector	20,000
Activity 2.5.3: Design programmes to facilitate improvement to the maintenance of personal transport (cars), including training of mechanics and police.	Police Department	High	1 year	Improved efficiency of vehicles. Reduced fuel use and consumption	10,000

Activity 2.5.4: Establish a data collection system for energy and transport data.	Police, MOI	High	6 months to 1 year	Energy and transport data readily available	20,000
Strategy 2.6: Investigate cleaner fuel for land transport					
Activity 2.6.1: Study the feasibility of LPG use for transport sector, including infrastructure requirements.	NBF MOI/Transport Department	High	1 to 2 years	Feasibility of options established	25,000
Activity 2.6.2: Battery – electric vehicle demonstration and fuel usage monitored.	Niue Tourism, IUCN	High	1 to 2 years	Vehicle use is monitored	11,000
Activity 2.6.3: Feasibility study on hybrid and electric vehicles use in Niue (this can be done by a master's student).	MOI/Transport Department	Very high	1 to 2 years	Information available and a hybrid – electric vehicle used	30,000

Strategy 2.7: Replace electricity use with LPG for cooking					
Activity 2.7.1: Rehabilitate the EDF9 LPG stove project – including training and awareness of LPG use.	NBF,SPC	Very high	1 year	Demand for electricity grid and diesel use is reduced	100,000

Strategy 2.7.8 Efficiency in the water sector					
Activity 2.8.1: Reduce water leakages and water flow at storage and reservoirs on mains and service connections up to meter.	MOI/Utilities Department	Very high	3 years	Demand for electricity grid and diesel use is reduced. User-pays system established	1,500,000

INTERVENTION LOGIC	INDICATORS	RELEVANT TARGETS	MEANS OF VERIFICATION	RISKS AND ASSUMPTIONS
Goal 3: Reliable energy supply	Indicator 1: Fuel supply security (days)	60 days by 2020	Monthly petroleum imports data	Political support Financial support
	Indicator 2: Percentage of the average forced outage	Below regional average of 5.4%	Electricity generation data	Technical resources
	Indicator 3: Average outage duration for each customer served (SAIDI)	Less than 200 minutes per customer	Electricity generation data	Technical expertise Financial resources to carry out maintenance regularly

Strategy 3.1: Efficient fuel supply and storage logistics

Activities	Organisation Responsible (supporting organisations)	Activity - Importance	Time-frame	Expected outputs/results	Estimated cost NZD
Activity 3.1.1: Economic study/analysis of the fuel supply and storage options of tank-tainers versus local coastal tankers	NBF, SPC	Very high	1 year	Economic study available	15,000
Activity 3.1.2: Regulate fuel pricing.	NBF, MOI/DOU	Medium	Ongoing	Fuel price templates used effectively	10,000
Activity 3.1.3: Rehabilitate the EDF9 LPG stove project – including training and awareness on LPG use.	NBF, SPC	Very high	1 year	LPG use for cooking increased Electricity use for residential cooking reduced	50,000
Activity 3.1.4: Construct new LPG filling facility.	NBF	High	1 year	Safety standards upgraded Reduced risks of improper storage	300,000

Strategy 3.3: Reduce interruptions to power						
Activity 3.3.1: Establish an effective maintenance and servicing plan and proper data recording.	NPC	Very high	1 year	Generation data reliability Reliable performance data available	2,000,000	
Strategy 3.2: Improve resilience of energy infrastructure						
Activity 3.2.1: Improve fuel storage and distribution facility (NBF and NPC) – a need to move the storage facilities inland.	NBF	Very high	2 years	Resilience of fuel storage tanks and distribution facilities improved.	6,000,000	
Activity 3.2.3: Capacity building (certification and training) – over ten-year plan	NBF	High	10 year	At least one staff member trained a year and compliance to standards met.	300,000	

For more information, please contact:

Andre Maurice Siohane
Director General
Ministry of Infrastructure – Communications,
Utilities, Transport
Government of Niue – Alofi
Niue Island
Ph +(683) 4018
Andre.Siohane@mail.gove.nu

Angela Tuhipa
Establishment Director
Project Management & Coordination Unit
angela.tuhipa@mail.gov.nu
Phone: +683 4159
Mobile: +683 5924
www.gov.nu

